

**www.ramcoi.com**  
**Got Questions?**  
**email [sales@ramcoi.com](mailto:sales@ramcoi.com)**  
**Phone 800-328-6236**

# S4B Safety Light Curtain Instruction Manual



Original Instructions  
p/n: 230287 Rev. B  
April 09, 2024

© Banner Engineering Corp. All rights reserved.

# Contents

## Chapter 1 About This Document

1.1 Important... Read This Before Proceeding! .....	5
1.2 Use of Warnings and Cautions .....	5
1.3 EU Declaration of Conformity (DoC) .....	6

## Chapter 2 Standards and Regulations

2.1 Applicable US Standards .....	7
2.2 OSHA Regulations .....	8
2.3 International/European Standards .....	8

## Chapter 3 Introduction

3.1 Features .....	9
3.2 System Description .....	9
3.2.1 Components .....	10
3.2.2 Models .....	10
3.2.3 Ordering Guide .....	11
3.2.4 S4B Light Curtains with Different FIDs .....	11
3.3 Appropriate Applications and Limitations .....	12
3.3.1 Appropriate Applications .....	12
3.3.2 Examples: Inappropriate Applications .....	13
3.4 Control Reliability: Redundancy and Self-Checking .....	13
3.5 Operating Features .....	14
3.5.1 Emitter Wiring Options .....	14
3.5.2 Status Indicators .....	14
3.5.3 Trip Output .....	14
3.5.4 External Device Monitoring (EDM) .....	15
3.5.5 Scan Code Configuration .....	15
3.5.6 Weak Beam Strength Indication .....	15
3.5.7 Cascading .....	15

## Chapter 4 Specifications

4.1 General Specifications .....	16
4.2 Emitter Specifications .....	16
4.3 Receiver Specifications .....	17
4.4 Mounting Dimensions and Defined Area .....	18

## Chapter 5 Mechanical Installation

5.1 Mechanical Installation Considerations .....	19
5.2 Calculating the Safety Distance (Minimum Distance) .....	20
5.2.1 Formula and Examples .....	20
5.2.2 Examples .....	22
5.2.3 U.S. Applications, Model S4BR30-600-S .....	22
5.2.4 European Applications, Model S4BR30-600-S .....	22
5.3 Reducing or Eliminating Pass-Through Hazards .....	22
5.4 Supplemental Safeguarding .....	23
5.5 Reset Switch Location .....	24
5.6 Other Considerations .....	25
5.6.1 Adjacent Reflective Surfaces .....	25
5.6.2 Use of Corner Mirrors .....	26
5.6.3 Emitter and Receiver Orientation .....	27
5.6.4 Installation of Multiple Systems .....	28
5.7 Mounting System Components .....	30
5.7.1 Mounting Hardware .....	30
5.7.2 Sensor Mounting and Mechanical Alignment Verification .....	32

## Chapter 6 Electrical Installation and Testing

6.1 Routing Cordsets .....	33
6.2 Scan Code Selection .....	34
6.3 Initial Electrical Connections .....	35
6.4 Initial Checkout Procedure .....	35
6.4.1 Configuring the System for Initial Checkout .....	35
6.4.2 Apply Initial Power to the System .....	36
6.4.3 Optically Align the System Components .....	36
6.4.4 Optical Alignment Procedure with Mirrors .....	37

6.4.5 Conduct a Trip Test .....	38
6.5 Electrical Connections to the Guarded Machine .....	40
6.5.1 OSSD Output Connections .....	40
6.5.2 Protective Stop (Safety Stop) Circuits .....	41
6.5.3 Preparing for System Operation .....	42
6.5.4 Sensor Interchangeability .....	43
6.5.5 Commissioning Checkout .....	44
6.6 Wiring Diagrams .....	46
6.6.1 Generic Emitter Wiring Diagram .....	46
6.6.2 Generic Wiring Diagram— 5-pin Receiver and Self-checking Safety Module, Safety Controller, Safety PLC .....	47
6.6.3 Generic Wiring Diagram—8-pin Receiver and a Smart Device .....	48
6.6.4 Generic Wiring Diagram—8-pin Receiver and Redundant FSDs .....	49
6.6.5 Generic Wiring Diagram—8-pin Receiver and IM-T-9A Interface Module .....	50

## Chapter 7 System Operation

7.1 Security Protocol .....	51
7.2 Normal Operation .....	51
7.2.1 System Power-Up .....	51
7.2.2 Run Mode .....	51
7.2.3 Emitter Indicators .....	51
7.2.4 Receiver Indicators .....	52
7.3 Periodic Checkout Requirements .....	53

## Chapter 8 Troubleshooting

8.1 Lockout Conditions .....	54
8.2 Receiver Error Codes .....	54
8.3 Electrical and Optical Noise .....	55
8.3.1 Checking for Sources of Electrical Noise .....	55
8.3.2 Check for Sources of Optical Noise .....	55

## Chapter 9 Cascade

9.1 Overview of Cascading .....	56
9.1.1 System Components and Specifications .....	57
9.2 Configuring Cascade Systems .....	57
9.2.1 Initial Configuration or Add Units to the Cascade Chain .....	57
9.2.2 Reduce the Number of Units in a Cascade Chain .....	58
9.3 Determining Interconnect Cordset Lengths .....	59
9.4 Response Time for Cascaded Light Curtains .....	59
9.4.1 Determining Worst Case System Response Time .....	60
9.4.2 Determining System Response Time .....	60
9.4.3 Individual Response Time and Safety (Minimum) Distance .....	61
9.4.4 Recovery Time (Off to On) for Cascaded Light Curtains .....	61

## Chapter 10 Checkout Procedures

10.1 Schedule of Checkouts .....	63
----------------------------------	----

## Chapter 11 Product Support and Maintenance

11.1 Cleaning .....	64
11.2 Warranty Service .....	64
11.3 Manufacturing Date .....	64
11.4 Disposal .....	64
11.5 Banner Engineering Corp Limited Warranty .....	64
11.6 Contact Us .....	65

## Chapter 12 Accessories

12.1 Safety Controllers .....	66
12.2 Interface Modules .....	66
12.3 Contactors .....	67
12.4 In-Line Sensor Status Indicator .....	67
12.5 Literature .....	67
12.6 Brackets .....	67
12.7 RD Cordsets—FID 1 Models .....	68
12.8 RD Cordsets—FID 2 Models .....	68
12.9 Cordsets .....	70
12.10 Test Piece .....	72
12.11 Universal (Input) Safety Modules .....	72
12.12 Alignment Aids .....	72

12.13 SSM Series Corner Mirrors ..... 72  
12.14 MSA Series Stands..... 73  
12.15 Muting Accessories..... 74

**Chapter 13 Glossary of Safety Terminology ..... 75**

**Index ..... 79**

Chapter Contents

1.1 Important... Read This Before Proceeding! ..... 5  
 1.2 Use of Warnings and Cautions..... 5  
 1.3 EU Declaration of Conformity (DoC) ..... 6

# Chapter 1 About This Document

## 1.1 Important... Read This Before Proceeding!

It is the responsibility of the machine designer, controls engineer, machine builder, machine operator, and/or maintenance personnel or electrician to apply and maintain this device in full compliance with all applicable regulations and standards. The device can provide the required safeguarding function only if it is properly installed, properly operated, and properly maintained. This manual attempts to provide complete installation, operation, and maintenance instructions. *Reading the manual in its entirety is highly recommended to ensure proper understanding of the operation, installation, and maintenance.* Please direct any questions regarding the application or use of the device to Banner.

For more information regarding U.S. and international institutions that provide safeguarding application and safeguarding device performance standards, see "[Standards and Regulations](#)" on page 7.

**WARNING:**



- The user is responsible for following these instructions.
- **Failure to follow any of these responsibilities may potentially create a dangerous condition that could result in serious injury or death.**
- Carefully read, understand, and comply with all instructions for this device.
- Perform a risk assessment that includes the specific machine guarding application. Guidance on a compliant methodology can be found in ISO 12100 or ANSI B11.0.
- Determine what safeguarding devices and methods are appropriate per the results of the risk assessment and implement per all applicable local, state, and national codes and regulations. See ISO 13849-1, ANSI B11.19, and/or other appropriate standards.
- Verify that the entire safeguarding system (including input devices, control systems, and output devices) is properly configured and installed, operational, and working as intended for the application.
- Periodically re-verify, as needed, that the entire safeguarding system is working as intended for the application.

## 1.2 Use of Warnings and Cautions

The precautions and statements used throughout this document are indicated by alert symbols and must be followed for the safe use of the S4B Safety Light Curtain. Failure to follow all precautions and alerts may result in unsafe use or operation. The following signal words and alert symbols are defined as follows:

Signal Word and Symbol	Definition
 <b>WARNING:</b>	<b>Warnings</b> refer to potentially hazardous situations which, if not avoided, could result in serious injury or death.
 <b>CAUTION:</b>	<b>Cautions</b> refer to potentially hazardous situations which, if not avoided, could result in minor or moderate injury.

These statements are intended to inform the machine designer and manufacturer, the end user, and maintenance personnel, how to avoid misapplication and effectively apply the S4B Safety Light Curtain to meet the various safeguarding application requirements. These individuals are responsible to read and abide by these statements.

## 1.3 EU Declaration of Conformity (DoC)

Banner Engineering Corp. herewith declares that these products are in conformity with the provisions of the listed directives and all essential health and safety requirements have been met. For the complete DoC, please go to [www.bannerengineering.com](http://www.bannerengineering.com).

Product	Directive
S4B Safety Light Curtain	EU: Machinery Directive 2006/42/EC

Representative in EU: Spiros Lachandidis, Managing Director, **Banner Engineering BV** Park Lane | Culliganlaan 2F bus 3 | 1831 Diegem, BELGIUM

Chapter Contents

2.1 Applicable US Standards..... 7  
2.2 OSHA Regulations ..... 8  
2.3 International/European Standards..... 8

# Chapter 2      Standards and Regulations

*The list of standards below is included as a convenience for users of this Banner device. Inclusion of the standards below does not imply that the device complies specifically with any standard, other than those specified in the Specifications section of this manual.*

## 2.1      Applicable US Standards

ANSI B11.0 Safety of Machinery

ANSI B11.1 Mechanical Power Presses

ANSI B11.2 Hydraulic Power Presses

ANSI B11.3 Power Press Brakes

ANSI B11.4 Shears

ANSI B11.5 Iron Workers

ANSI B11.6 Lathes

ANSI B11.7 Cold Headers and Cold Formers

ANSI B11.8 Drilling, Milling, and Boring

ANSI B11.9 Grinding Machines

ANSI B11.10 Metal Sawing Machines

ANSI B11.11 Gear Cutting Machines

ANSI B11.12 Roll Forming and Roll Bending Machines

ANSI B11.13 Single- and Multiple-Spindle Automatic Bar and Chucking Machines

ANSI B11.14 Coil Slitting Machines

ANSI B11.15 Pipe, Tube, and Shape Bending Machines

ANSI B11.16 Metal Powder Compacting Presses

ANSI B11.17 Horizontal Extrusion Presses

ANSI B11.18 Machinery and Machine Systems for the Processing of Coiled Strip, Sheet, and Plate

ANSI B11.19 Performance Requirements for Risk Reduction Measures: Safeguarding and Other Means of Reducing Risk

ANSI B11.20 Manufacturing Systems

ANSI B11.21 Machine Tools Using Lasers

ANSI B11.22 Numerically Controlled Turning Machines

ANSI B11.23 Machining Centers

ANSI B11.24 Transfer Machines

ANSI/RIA R15.06 Safety Requirements for Industrial Robots and Robot Systems

NFPA 79 Electrical Standard for Industrial Machinery

ANSI/PMMI B155.1 Package Machinery and Packaging-Related Converting Machinery — Safety Requirements

## 2.2 OSHA Regulations

OSHA Documents listed are part of: Code of Federal Regulations Title 29, Parts 1900 to 1910

OSHA 29 CFR 1910.212 General Requirements for (Guarding of) All Machines

OSHA 29 CFR 1910.147 The Control of Hazardous Energy (lockout/tagout)

OSHA 29 CFR 1910.217 (Guarding of) Mechanical Power Presses

## 2.3 International/European Standards

ISO 12100 Safety of Machinery – General Principles for Design – Risk Assessment and Risk Reduction

ISO 13857 Safety of Machinery – Safety Distances to Prevent Hazard Zones Being Reached

ISO 13850 (EN 418) Emergency Stop Devices, Functional Aspects – Principles for Design

ISO 13851 Two-Hand Control Devices – Principles for Design and Selection

IEC 62061 Safety of Machinery – Functional Safety of Safety-Related Control Systems

ISO 13849-1 Safety of Machinery – Safety-Related Parts of Control Systems – Part 1: General Principles for Design

EN 13855 (EN 999) The Positioning of Protective Equipment in Respect to Approach Speeds of Parts of the Human Body

ISO 14119 (EN 1088) Interlocking Devices Associated with Guards – Principles for Design and Selection

EN 60204-1 Electrical Equipment of Machines Part 1: General Requirements

IEC 61496 Electro-sensitive Protection Equipment

IEC 60529 Degrees of Protection Provided by Enclosures

IEC 60947-1 Low Voltage Switchgear – General Rules

IEC 60947-5-1 Low Voltage Switchgear – Electromechanical Control Circuit Devices

IEC 60947-5-5 Low Voltage Switchgear – Electrical Emergency Stop Device with Mechanical Latching Function

IEC 61508 Functional Safety of Electrical/Electronic/Programmable Electronic Safety-Related Systems

IEC 62046 Safety of Machinery – Applications of Protective Equipment to Detect the Presence of Persons

ISO 3691-4 Industrial Trucks – Safety Requirements and Verification, Part 4 Driverless Industrial trucks and their Systems




Chapter Contents

3.1 Features ..... 9  
 3.2 System Description ..... 9  
 3.3 Appropriate Applications and Limitations..... 12  
 3.4 Control Reliability: Redundancy and Self-Checking..... 13  
 3.5 Operating Features ..... 14

# Chapter 3 Introduction

## 3.1 Features

- A two-piece optoelectronic safeguarding device
- Creates a screen of synchronized, modulated infrared sensing beams that extend from end to end of the sensors (no "dead zone")
- Compact package for smaller production machines, robust for large power presses
- 14 mm and 30 mm resolutions
- Defined areas, in increments of 150 mm (6 in):
  - 14 mm resolution models: 300 mm (12 in) to 1200 mm (47 in)
  - 30 mm resolution models: 300 mm (12 in) to 1800 mm (71 in)
- 0.1 m to 12 m range (4 in to 39 ft); the range decreases with the use of corner mirrors and/or lens shields:
  - Lens Shields—an approximately 10% reduction in range per shield
  - Glass-surface mirrors—an approximately 8% reduction in range per mirror
- Zone and Status indicators for diagnostics
- FMEA tested to ensure control reliability
- Highly immune to EMI, RFI, ambient light, weld flash, and strobe light
- Safety PLC input compatible (per OSSD specifications)
- Up to 4 pairs of units can be cascaded together

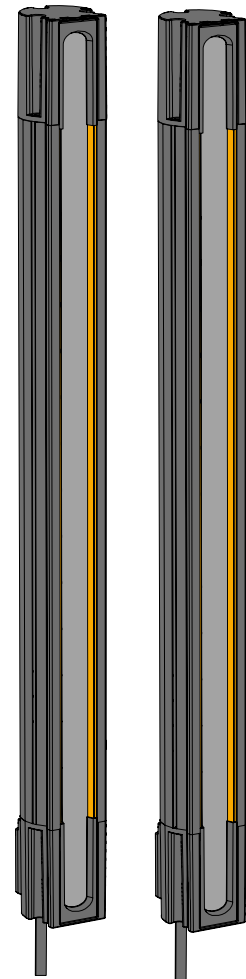

## 3.2 System Description

Banner S4B emitters and receivers provide a redundant, microprocessor-controlled, opposed-mode optoelectronic safety light curtain. S4B typically is used for point-of-operation safeguarding, and is suited to safeguard a variety of machinery.

The S4B emitters have a row of synchronized modulated infrared (invisible) light-emitting diodes (LEDs) in a compact housing. Receivers have a corresponding row of synchronized photodetectors. The light curtain created by the emitter and receiver is called the defined area; its width and height are determined by the length of the sensor pair and the distance between them. The maximum sensing range is 12 m (39 ft), which decreases if corner mirrors or lens shields are used. The defined area (sensing range) is equivalent to the height of the sensors (14 mm resolution models: 300 mm (12 in) to 1200 mm (47 in) and 30 mm resolution models: 300 mm (12 in) to 1800 mm (71 in), in 150 mm (6 in) increments). The sensing area extends from end to end of the housing, also known as 'no dead zone' or 'no blink zone'. The end-to-end sensing design of the S4B allows mounting with minimal or no gaps in detection when using S4BA-MBK-16 brackets.

The S4B models have trip outputs (auto power-up and automatic reset). In typical operation, if any part of an operator's body or any opaque object of more than a pre-determined cross section is detected, the solid-state output signal switching device (OSSD) safety outputs turn off. These safety outputs are connected to the guarded machine's final switching devices (FSDs) that control the machine primary control elements (MPCEs), which immediately stop the motion of the guarded machine. When the defined area becomes clear, the OSSD outputs are allowed to turn ON.

Eight-conductor S4B systems (receivers with an 8-pin RD (removable disconnect) cordset) do not require an external controller when using the external device monitoring (EDM) function. This function ensures the fault detection capability required by U.S. Control Reliability and ISO 13849-1 Categories 3 or 4 and PL d or e for controlling final switching devices (FSDs) or Machine Primary Control Elements (MPCEs).

Five-conductor S4B systems (receivers with 5-pin RD (removable disconnect) cordset) require a self-checking safety module, safety controller, or safety PLC/PES that conforms to the level of performance required by the risk assessment. Examples include the UM-FA-9A/11A safety module, SC10-2roe or XS/SC26 safety controller for applications requiring Control Reliability and/or ISO 13849-1 Categories 3 or 4 and PL d or e.

Electrical connections (power, ground, inputs, and outputs) are made via M12 quick-disconnect connections.

All models require a supply voltage of +24 V DC ±15%.


FID 2 models can be used in a cascade configuration if the appropriate RD (removeable disconnect) cordsets are selected. Up to four sensor pairs (any length or resolution) can be automatically configured in a cascade chain (when adding sensor pairs).

All models include the ability to select between two scan codes.

### 3.2.1 Components

An S4B 'System' refers to a compatible emitter and receiver of equal length and resolution, including cascaded configurations, and their cordsets. RD (removeable disconnect) cordset to M12 cordsets, mounting brackets, and specified test pieces are sold separately. Depending on the connection option, interfacing solutions include SR-IM-.. modules, redundant positively guided contactors, and safety modules/controllers, which are sold separately.

Figure 1. Main Components

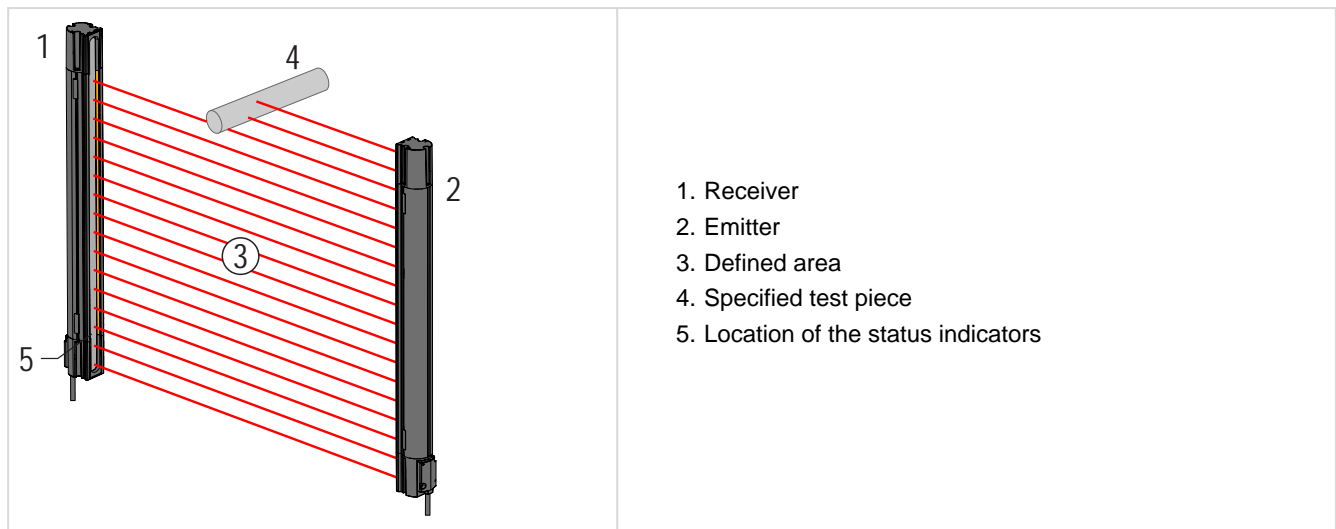

### 3.2.2 Models

Table 1. 30 mm Models

Emitter	Receiver	Defined Area (mm)	Response Time, Tr (ms)	Recovery Time, OSSDs OFF to ON (ms)	
				Non-Sync Beam Blocked	All Beams Blocked
S4BE30-300-S	S4BR30-300-S	300	7.5	30 typical	49 typical, 295 maximum
S4BE30-450-S	S4BR30-450-S	450	8.5	36 typical	65 typical, 337 maximum
S4BE30-600-S	S4BR30-600-S	600	10.0	42 typical	75 typical, 379 maximum
S4BE30-750-S	S4BR30-750-S	750	11.5	48 typical	85 typical, 421 maximum
S4BE30-900-S	S4BR30-900-S	900	12.5	54 typical	98 typical, 463 maximum
S4BE30-1050-S	S4BR30-1050-S	1050	14.0	60 typical	112 typical, 506 maximum
S4BE30-1200-S	S4BR30-1200-S	1200	15.0	66 typical	122 typical, 544 maximum
S4BE30-1350-S	S4BR30-1350-S	1350	16.5	73 typical	128 typical, 582 maximum
S4BE30-1500-S	S4BR30-1500-S	1500	17.5	79 typical	141 typical, 620 maximum
S4BE30-1650-S	S4BR30-1650-S	1650	19.0	84 typical	150 typical, 658 maximum
S4BE30-1800-S	S4BR30-1800-S	1800	20.0	91 typical	172 typical, 697 maximum

Table 2. 14 mm Models

Emitter	Receiver	Defined Area (mm)	Response Time, Tr (ms)	Recovery Time, OSSDs OFF to ON (ms)	
				Non-Sync Beam Blocked	All Beams Blocked
S4BE14-300-S	S4BR14-300-S	300	11.5	48 typical	85 typical, 421 maximum
S4BE14-450-S	S4BR14-450-S	450	14.5	63 typical	117 typical, 525 maximum
S4BE14-600-S	S4BR14-600-S	600	17.5	78 typical	141 typical, 620 maximum
S4BE14-750-S	S4BR14-750-S	750	21.0	94 typical	178 typical, 736 maximum
S4BE14-900-S	S4BR14-900-S	900	24.0	108 typical	209 typical, 841 maximum
S4BE14-1050-S	S4BR14-1050-S	1050	27.0	124 typical	240 typical, 946 maximum
S4BE14-1200-S	S4BR14-1200-S	1200	30.5	137 typical	271 typical, 1051 maximum

### 3.2.3 Ordering Guide

To order a complete S4B system:

1. Determine if the application calls for a stand-alone emitter and receiver pair or if multiple pairs are to be used as part of a cascade system.
2. Choose the model numbers needed for the application.
  - Resolution: 14 mm or 30 mm
  - Appropriate length:
    - 14 mm resolution models: 300 mm to 1200 mm
    - 30 mm resolution models: 300 mm to 1800 mm
3. Determine the connection style, which is typically dictated by the type of interfacing with the machine's safety-related control system.

See ["Accessories" on page 66](#) for RD (removable disconnect) cordset options (5-pin or 8-pin).
4. Determine the desired mounting option to be used.

See ["Accessories" on page 66](#).
5. Determine the appropriate cabling needed for the application—machine interface cables and double-ended cables for the cascade configuration (if a cascade is being used).

See ["Accessories" on page 66](#).

### 3.2.4 S4B Light Curtains with Different FIDs

Over time, Banner adds new features to some devices. The Feature ID (FID) identifies the set of features and functions included in a particular model.

Generally, an increasing FID number corresponds to an increasing feature set. Optically, units of the same resolution and length can be interchanged and will work, regardless of FID. Different FIDs might require different models of interfacing RD (removable disconnect) cordsets (more features require different connectors). See the label on the S4B to determine the FID of a particular device.

Figure 2. Example Label

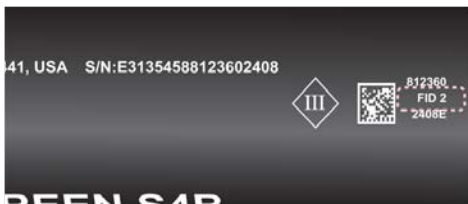


Table 3. FID Descriptions

FID Number	Added Feature Set
FID 1	Initial release. No FID indication on the device.
FID 2	Added cascade ability. Added EDM ability (with 8-pin RD cordsets).

## 3.3 Appropriate Applications and Limitations

### WARNING:



- **Read this Section Carefully Before Installing the System**
- **Failure to follow these instructions could result in serious injury or death.**
- If all mounting, installation, interfacing, and checkout procedures are not followed properly, this Banner device cannot provide the protection for which it was designed.
- The user is responsible for ensuring that all local, state, and national laws, rules, codes, or regulations relating to the installation and use of this control system in any particular application are satisfied. Ensure that all legal requirements have been met and that all technical installation and maintenance instructions contained in this manual are followed.
- The user has the sole responsibility to ensure that this Banner device is installed and interfaced to the guarded machine by Qualified Persons, in accordance with this manual and applicable safety regulations. A Qualified person is a person who, by possession of a recognized degree or certificate of professional training, or who, by extensive knowledge, training and experience, has successfully demonstrated the ability to solve problems relating to the subject matter and work.

The Banner S4B is intended for point-of-operation machine guarding and other safeguarding applications. It is the user's responsibility to verify whether the safeguarding is appropriate for the application and is installed, as instructed by this manual, by a Qualified Person.

The ability of the S4B to perform its safeguarding function depends upon the appropriateness of the application and upon its proper mechanical and electrical installation and interfacing to the guarded machine. **If all mounting, installation, interfacing, and checkout procedures are not followed properly, the S4B cannot provide the protection for which it was designed.**

### WARNING:




- **Install System Only on Appropriate Applications**
- Failure to follow these instructions could result in serious injury or death.
- Use Banner's S4B only on machinery that can be stopped immediately after a stop signal is issued at any point in the machine's stroke or cycle, such as part-revolution clutched machines. Under no circumstances may the S4B be used on full-revolution clutched machinery or in unsuitable applications.
- If there is any doubt about whether or not your machinery is compatible with the S4B, contact Banner Engineering.

### 3.3.1 Appropriate Applications

S4B is typically used for, but is not limited to, the following applications:

- Small assembly equipment
- Automated production equipment
- Robotic work cells
- Molding and power presses
- Assembly and packaging machines
- Lean manufacturing systems

Figure 3. Typical Application

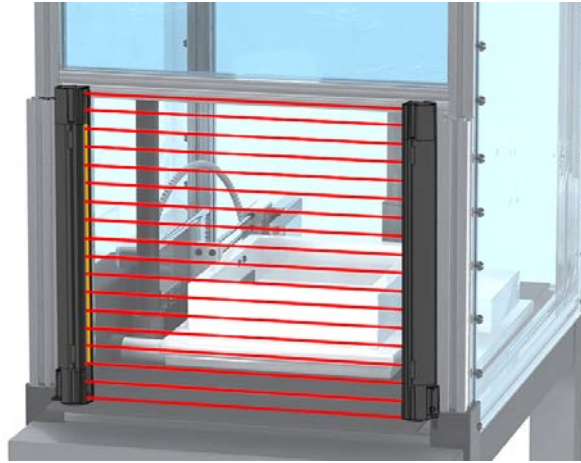

### 3.3.2 Examples: Inappropriate Applications

Do not use the S4B in the following applications:

- With any machine that cannot be stopped immediately after a stop signal is issued, such as single-stroke (or full-revolution) clutched machinery
- With any machine with inadequate or inconsistent machine response time and stopping performance
- With any machine that ejects materials or component parts through the defined area
- In any environment that is likely to adversely affect photoelectric sensing efficiency. For example, corrosive chemicals or fluids or unusually severe levels of smoke or dust, if not controlled, may degrade sensing efficiency
- As a tripping device to initiate or reinitiate machine motion (PSDI applications), unless the machine and its control system fully comply with the relevant standard or regulation (see OSHA 29CFR1910.217, NFPA 79, ANSI B11.19, ISO 12100, IEC 60204-1, IEC 61496-1, or other appropriate standard)

If the S4B is installed for use as a perimeter guard (where a pass-through hazard may exist, see "[Reducing or Eliminating Pass-Through Hazards](#)" on page 22), the dangerous machine motion can be initiated by normal means only after the safeguarded area is clear of individuals and the external safety monitoring device has been manually reset.

## 3.4 Control Reliability: Redundancy and Self-Checking

Redundancy requires that S4B circuit components be backed up to the extent that, if the failure of a single component will prevent effective machine stopping action when needed, that component must have a redundant counterpart which will perform the same function. The S4B is designed with redundant microprocessors.

Redundancy must be maintained whenever the S4B is in operation. Because a redundant system is no longer redundant after a component has failed, S4B is designed to monitor itself continuously. A component failure detected by or within the self-checking system causes a stop signal to be sent to the guarded machine and puts the S4B into a Lockout condition.

A recovery from this type of Lockout condition requires:

- Replacing the failed component (to restore redundancy), and
- Performing the appropriate reset procedure.

## 3.5 Operating Features

The sensing resolution is determined by the emitter and receiver model.

**WARNING:**



- **Use of automatic (trip) or manual (latch) start/restart**
- Failure to follow these instructions could result in a serious injury or death.
- Applying power to the Banner device, clearing the defined area, or resetting a latch condition must not initiate dangerous machine motion. Design the machine control circuitry so that one or more initiation devices must be engaged to start the machine (a conscious act), in addition to the Banner device going into Run mode.

### 3.5.1 Emitter Wiring Options

An S4B emitter can be connected either to its own power supply or to the receiver cable, color-for-color. The color-for-color wiring allows the emitter and receiver positions to be interchanged without rewiring.

### 3.5.2 Status Indicators

Status indicators on both the emitter and receiver are clearly visible on the front panel of each sensor.

For more information, see "[System Operation](#)" on page 51.

Table 4. Emitter Status Indicators

Key	Description	
1	Status indicator (red/green)—shows whether power is applied (green), device is in a lockout condition (red flash), or the number of units in a cascade chain (green flash).	
2	Scan Code indicator (red/green/yellow)—shows the scan code setting (1 or 2) at power-up	

Table 5. Receiver Status Indicators

Key	Description	
1	Status indicator (red/green)—shows System status: <ul style="list-style-type: none"> <li>• Outputs are ON or OFF (green ON or red ON)</li> <li>• The System is in Lockout condition (flashing red)</li> <li>• Indicates the number of units in a cascade chain (green flash)</li> </ul>	
2	Zone indicators (red/green/yellow)—each shows the status of approximately 1/3 of the total beams: <ul style="list-style-type: none"> <li>• Aligned and clear (green ON)</li> <li>• Blocked and/or misaligned (red ON)</li> <li>• All beams are clear, but one or more beams have weak beam strength (yellow ON)</li> </ul> <p>The Zone 1 indicator, at the bottom of this view, represents the 1/3 of the unit that is toward the RD cordset end of the unit. The Zone 2 indicator is in the middle and represents the middle 1/3 of the unit. The Zone 3 indicator is at the top and represents the 1/3 of the unit closest to the end cap.</p>	
3	Zone 1 Indicator—indicates beam synchronization status	

### 3.5.3 Trip Output

The System is configured for Trip Output which allows the System to enter Run mode automatically. Other measures must be taken to prevent a pass-through hazard; see "[Reducing or Eliminating Pass-Through Hazards](#)" on page 22 and the warning below for more information.

The OSSD outputs turn ON after power is applied, and the receiver passes its internal self-test/synchronization and recognizes that all beams are clear. The Trip Output also automatically resets after all beams are cleared.

**WARNING:**

- **Use of automatic (trip) or manual (latch) start/restart**
- Failure to follow these instructions could result in a serious injury or death.
- Applying power to the Banner device, clearing the defined area, or resetting a latch condition must not initiate dangerous machine motion. Design the machine control circuitry so that one or more initiation devices must be engaged to start the machine (a conscious act), in addition to the Banner device going into Run mode.

### 3.5.4 External Device Monitoring (EDM)

The External Device Monitoring (EDM) feature allows the S4B to monitor the status of external devices, such as Machine Primary Control Elements (MPCEs). The choices are 1-channel monitoring or no monitoring. EDM is used when the S4B OSSD outputs directly control the MPCEs or other external devices.

This feature is only available when an 8-conductor interface is used.

### 3.5.5 Scan Code Configuration

Use the scan code to allow the operation of multiple pairs of emitters and receivers that are in close proximity, without the effects of crosstalk.

The emitter and receiver may be configured to use one of two scan codes (1 or 2); a receiver recognizes light only from an emitter with the same scan code. Set the scan code switches of the RD cordset of each sensor (see "[Scan Code Selection](#)" on page 34). Both the emitter and its corresponding receiver must have the same setting. Cascaded emitters and receivers automatically alternate scan codes based on the scan code of the first (host) pair.

The default setting is scan code 1.

### 3.5.6 Weak Beam Strength Indication

Weak beam strength is indicated when one or more channels are made, but the beam strength is marginal. This indication can be used to aid alignment of the sensor and also to indicate when window cleaning might be needed.

The Zone indicator representing the area of the channel(s) with the weak beam strength immediately turns yellow when the marginal signal is detected.

The Weak Beam Strength Output (pin 5 for 5-pin receivers, pin 3 for 8-pin receivers) turns ON any time one or more channels are detected with a marginal signal for longer than 1 minute. After the signal rises above the marginal level, the Weak Beam Strength Output turns OFF.

### 3.5.7 Cascading

Up to four sensor pairs (any length or resolution) can be combined into one system.

The cascade system automatically configures at power up when sensor pairs are added to the cascade chain. Removing sensor pairs from the chain requires operator intervention. See "[Configuring Cascade Systems](#)" on page 57.



Chapter Contents

4.1 General Specifications ..... 16  
 4.2 Emitter Specifications..... 16  
 4.3 Receiver Specifications..... 17  
 4.4 Mounting Dimensions and Defined Area ..... 18

# Chapter 4 Specifications

## 4.1 General Specifications

**Short Circuit Protection**

All inputs and outputs are protected from short circuits to +24 V DC or DC common

**Electrical Safety Class**

III (per IEC 61140)

**Safety Ratings**

Type 4 per IEC 61496-1, -2  
 Category 4 PL e per EN ISO 13849-1:2015  
 SIL3 per IEC 61508

Configuration	PFH <sub>d</sub> (IEC 61508)	MTTF <sub>d</sub> (EN ISO 13849-1)
1-pair cascade (standalone)	$7.68 \times 10^{-9}$	176 years
2-pair cascade (host + 1 guest)	$1.36 \times 10^{-8}$	91 years
3-pair cascade (host + 2 guest)	$1.96 \times 10^{-8}$	61 years
4-pair cascade (host + 3 guest)	$2.56 \times 10^{-8}$	46 years

Proof Test Interval: 20 years

**Effective Aperture Angle (EAA)**

Meets Type 4 requirements per IEC 61496-2

**Operating Conditions**

-20 °C to +55 °C (-4 °F to +131°F)  
 95% maximum relative humidity (non-condensing)

**Storage Temperature**

-30 °C to +65 °C (-22 °F to +149 °F)

**Environmental Rating**

For indoor use only  
 IP65 (EN 60529)

**Resolution**

14 mm and 30 mm

**Operating Range**

0.1 m to 12 m (4 in to 39 ft)

**Enclosure**

Anodized aluminum housing with well-sealed zinc die-cast end-caps, polycarbonate window

**Mounting Hardware**

Mounting hardware is ordered separately.  
 Models longer than 900 mm require an additional side mount bracket.  
 Side mount brackets are made of glass-filled polycarbonate.  
 End mounting brackets have a glass-filled polycarbonate adapter and 8-gauge cold-rolled steel, black zinc finish brackets.

**Vibration and Mechanical Shock**

Components have passed vibration and shock tests according to IEC 61496-1 (Class 3M4). This includes vibration (30 cycles) of 5 Hz to 150 Hz at 3.5 mm (0.14 in) amplitude and 1 g acceleration, and shock of 15 g for 6 milliseconds (600 cycles).

**Certifications**



## 4.2 Emitter Specifications

**Supply Voltage at the Device**

+24 V DC ±15% (use a SELV-rated power supply according to EN IEC 60950)  
 Power supply must meet the requirements of IEC 60204-1.

**Residual Ripple**

± 10% maximum

**Status Indicators**

One bi-color (red/green) Status Indicator: indicates operating mode, lockout or power Off condition  
 Two tri-color (red/green/yellow) Scan Code Indicators: shows scan code setting (1 or 2) at power-up

**Supply Current**

33 mA typical  
 46 mA maximum<sup>(1)</sup>

**Wavelength of Emitter Elements**

Infrared LEDs, 860 nm at peak emission

**Controls and Adjustments**

Scan Code Selection: 2 dual-position switches, located in the RD (removable disconnect) cordset, to select between scan codes (code 1 or 2)

Factory default position is scan code 1

<sup>(1)</sup> Maximum current occurs at a supply voltage of 20 V DC.



## 4.3 Receiver Specifications

### Supply Voltage at the Device

+24 V DC  $\pm 15\%$  (use a SELV-rated power supply according to EN IEC 60950)

Power supply must meet the requirements of IEC 60204-1.

### Residual Ripple

$\pm 10\%$  maximum

### Status Indicators

Bi-color (red/green) Status indicator: indicates general system and output status

Tri-color (red/green/yellow) Zone Status indicators: indicate condition (clear, weak, or blocked beam) of a defined group of beams and also shows the scan code at start up

### Output Signal Switching Devices (OSSDs)

Two redundant solid-state 24 V DC, 0.5 A maximum sourcing OSSD (Output Signal Switching Device) safety outputs (use optional interface solutions for AC or larger DC loads)

ON-State voltage:  $> V_{in} - 1.5$  V DC

OFF-State voltage: 0 V DC typical, 1 V DC maximum (no load)

OFF-State, maximum allowed external voltage: 1.5 V DC<sup>(1)</sup>

Maximum load capacitance: 1.0  $\mu$ F

Maximum cable resistance to load: 5 ohms per wire

Maximum leakage current: 50  $\mu$ A (with open 0 V)

OSSD test pulse width: 200  $\mu$ s typical

OSSD test pulse period: 200 ms typical

Switching current: 0 A minimum; 0.5 A maximum (per OSSD)

<sup>(1)</sup> The maximum voltage allowed on the OSSDs in the OFF-state without a lockout occurring. This voltage may occur, for example, from the input structure of a safety relay module connected to the S4B OSSDs.

### Weak Beam Strength Output

Current-sourcing (PNP) solid-state output, 100 mA at 24 V DC

### Supply Current (no load)

72 mA typical

100 mA maximum<sup>(2)</sup>

Exclusive of OSSD1 and OSSD2 loads (up to additional 0.5 A each)

### Response Time

See "Models" on page 10

### Recovery Time

Blocked to Clear (OSSDs Off to On; varies with total number of sensing beams and whether Sync beam is blocked).

See "Models" on page 10

### Controls and Adjustments

Scan Code Selection: 2 dual position switches, located in the RD (removable disconnect) cordset, to select between scan codes (code 1 or 2)

Factory default position is scan code 1

### EDM Input (Available with 8-Conductor Models)

+24 V DC signals from external device contacts can be monitored (one channel or no monitoring) via the EDM terminal in the receiver.


High Signal: 10 V DC to 30 V DC at 30 mA, typical

Low Signal: 0 V DC to 3 V DC

<sup>(2)</sup> Maximum current occurs at a supply voltage of 20 V DC.

# 4.4 Mounting Dimensions and Defined Area

All measurements are listed in millimeters [inches], unless noted otherwise.

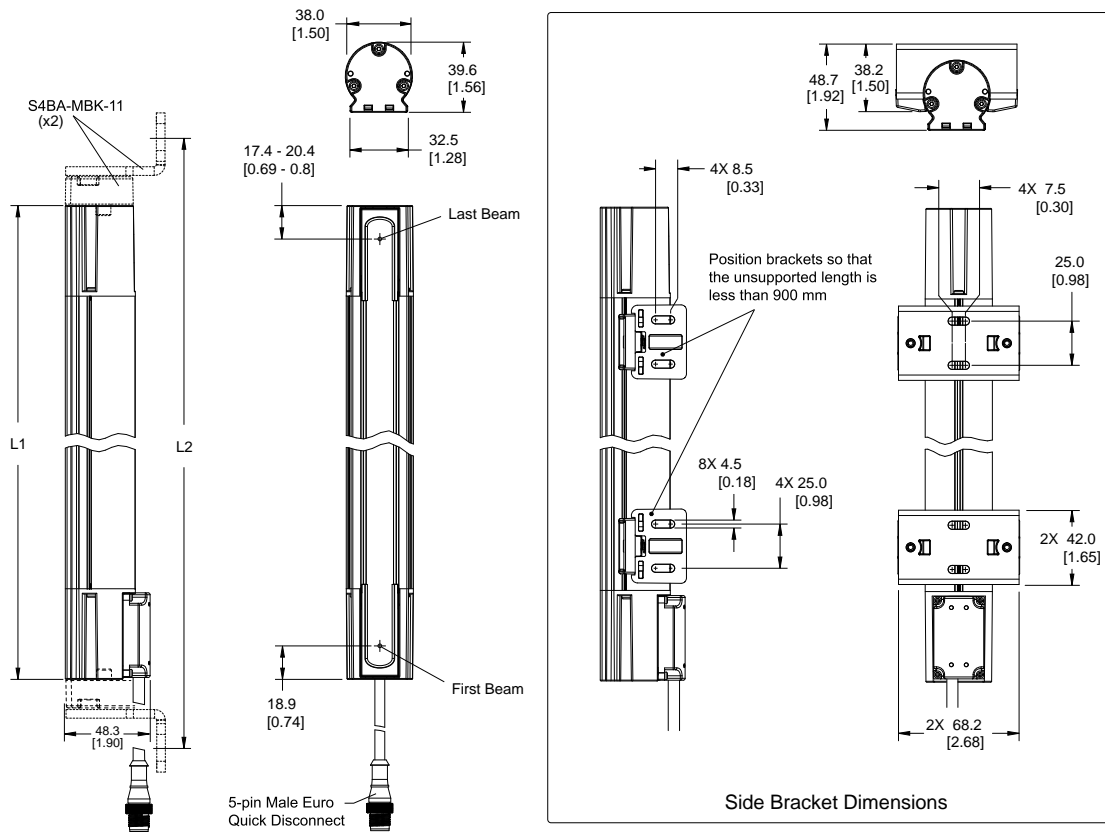

Emitter/Receiver Model	Housing Length (L1)	Hole to Hole Length with Brackets Out (L2)	Defined Area (mm)
S4B...-300-S	312.03 mm (12.28 in)	370.43 mm (14.58 in)	300
S4B...-450-S	460.73 mm (18.14 in)	519.13 mm (20.44 in)	450
S4B...-600-S	609.98 mm (24.01 in)	668.38 mm (26.31 in)	600
S4B...-750-S	758.68 mm (29.87 in)	817.08 mm (32.17 in)	750
S4B...-900-S	907.93 mm (35.75 in)	966.33 mm (38.04 in)	900
S4B...-1050-S	1056.63 mm (41.6 in)	1115.03 mm (43.90 in)	1050
S4B...-1200-S	1205.88 mm (47.48 in)	1264.28 mm (49.77 in)	1200
S4B...-1350-S	1354.58 mm (53.33 in)	1412.98 mm (55.63 in)	1350
S4B...-1500-S	1503.83 mm (59.21 in)	1562.23 mm (61.51 in)	1500
S4B...-1650-S	1652.53 mm (65.06 in)	1710.93 mm (67.36 in)	1650
S4B...-1800-S	1801.78 mm (70.94 in)	1860.18 mm (73.24 in)	1800

Chapter Contents

5.1 Mechanical Installation Considerations ..... 19  
 5.2 Calculating the Safety Distance (Minimum Distance) ..... 20  
 5.3 Reducing or Eliminating Pass-Through Hazards ..... 22  
 5.4 Supplemental Safeguarding ..... 23  
 5.5 Reset Switch Location ..... 24  
 5.6 Other Considerations ..... 25  
 5.7 Mounting System Components ..... 30

# Chapter 5 Mechanical Installation

The S4B system performance as a safety guarding device depends on:

- The suitability of the application
- The proper mechanical and electrical installation and interfacing to the guarded machine

**WARNING:**



- **Read this Section Carefully Before Installing the System**
- **Failure to follow these instructions could result in serious injury or death.**
- If all mounting, installation, interfacing, and checkout procedures are not followed properly, this Banner device cannot provide the protection for which it was designed.
- The user is responsible for ensuring that all local, state, and national laws, rules, codes, or regulations relating to the installation and use of this control system in any particular application are satisfied. Ensure that all legal requirements have been met and that all technical installation and maintenance instructions contained in this manual are followed.
- The user has the sole responsibility to ensure that this Banner device is installed and interfaced to the guarded machine by Qualified Persons, in accordance with this manual and applicable safety regulations. A Qualified person is a person who, by possession of a recognized degree or certificate of professional training, or who, by extensive knowledge, training and experience, has successfully demonstrated the ability to solve problems relating to the subject matter and work.

## 5.1 Mechanical Installation Considerations

The two primary factors that influence the layout of the S4B system mechanical installation are:

- Safety Distance (Minimum Distance) (see "[Calculating the Safety Distance \(Minimum Distance\)](#)" on page 20)
- Supplemental safeguarding/eliminating pass-through hazards (see "[Reducing or Eliminating Pass-Through Hazards](#)" on page 22)

Other considerations include:

- Emitter and Receiver Orientation (see "[Emitter and Receiver Orientation](#)" on page 27)
- Adjacent Reflective Surfaces (see "[Adjacent Reflective Surfaces](#)" on page 25)
- Use of Corner Mirrors (see "[Use of Corner Mirrors](#)" on page 26)
- Installation of Multiple Systems (see "[Installation of Multiple Systems](#)" on page 28)

**WARNING:**



- **Position the System Components Carefully**
- Failure to observe this warning could result in serious injury or death.
- Position the system components such that the hazard cannot be accessed by reaching over, under, around, or through the sensing field. Additional and supplemental guarding may be required.

## 5.2 Calculating the Safety Distance (Minimum Distance)

Safety Distance ( $D_s$ ), also called Minimum Distance ( $S$ ), is the minimum distance required between the defined area and the closest reachable hazard point. The distance is calculated so that when an object or a person is detected (by blocking a sensing beam), the S4B sends a stop signal to the machine, causing it to stop by the time the object or person can reach any machine hazard point.


The distance is calculated differently for U.S. and European installations. Both methods take into account several factors, including a calculated human speed, the total system stopping time (which itself has several components), and the depth penetration factor. After the distance has been determined, record the calculated distance on the Daily Checkout Card.

**WARNING:**



- **Calculate the Safety Distance (Minimum Distance)**
- Failure to establish and maintain the safety distance (minimum distance) could result in serious injury or death.
- Mount the components at a distance from the nearest hazard such that an individual cannot reach the hazard before cessation of the hazardous motion or situation. Calculate this distance using the supplied formulas, as described by ANSI B11.19 and ISO 13855. Mount the components more than 100 mm (4 in) away from the hazard, regardless of the calculated value.

Figure 4. Safety distance (minimum distance) and hard (fixed) guarding

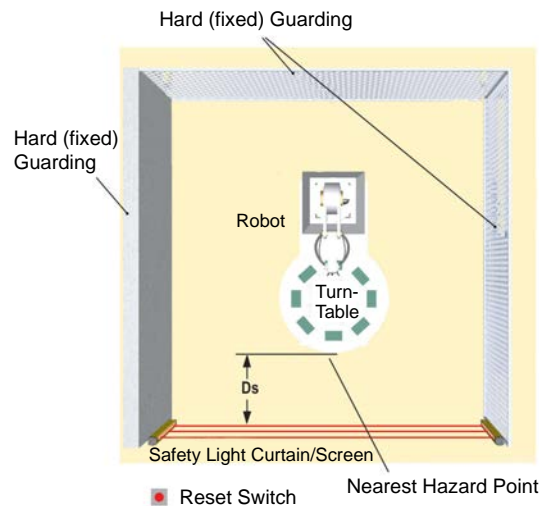

### 5.2.1 Formula and Examples

U.S. Applications	European Applications
The Safety (Separation) Distance formula for U.S. applications: $D_s = K \times (T_s + T_r) + D_{pf}$	The Minimum Distance formula for European applications: $S = (K \times T) + C$

Continued on page 21

Continued from page 20

U.S. Applications	European Applications
<p><b>D<sub>s</sub></b> the Safety Distance (in inches)</p> <p><b>K</b> 1600 mm per second (or 63 inches per second), the OSHA 29CFR1910.217, and ANSI B11.19 recommended hand-speed constant (see Note 1 below)</p> <p><b>T<sub>s</sub></b> the overall stop time of the machine (in seconds) from the initial stop signal to the final ceasing of all motion, including stop times of all relevant control elements (for example, XS26-2 Safety Controllers) and measured at maximum machine velocity (see Note 3 below)</p> <p><b>T<sub>r</sub></b> the maximum response time, in seconds, of the S4B emitter/receiver pair (depending on model)</p> <p><b>D<sub>pf</sub></b> the added distance due to the depth penetration factor as prescribed in OSHA 29CFR1910.217, and ANSI B11.19 for U.S. applications. See Depth Penetration Factor (D<sub>pf</sub>) table below or calculate using the formula (in mm): <math>D_{pf} = 3.4 \times (S - 7)</math> where S is the resolution of the light curtain (for <math>S \leq 63</math> mm).</p>	<p><b>S</b> the Minimum Distance, in mm, from danger zone to light curtain center line; minimum allowable distance is 100 mm (175 mm for non-industrial applications), regardless of calculated value</p> <p><b>K</b> hand-speed constant (see Note 2 below); <b>2000 mm/s</b> (for Minimum Distances <math>\leq 500</math> mm), <b>1600 mm/s</b> (for Minimum Distances <math>&gt; 500</math> mm)</p> <p><b>T</b> the overall machine stopping response time (in seconds), from the physical initiation of the safety device and the machine coming to a stop (or the hazard removed). This can be broken down into two parts: <b>T<sub>s</sub></b> and <b>T<sub>r</sub></b> where <math>T = T_s + T_r</math></p> <p><b>C</b> the additional distance, in mm, based on intrusion of a hand or object towards the danger zone prior to actuation of a safety device. Calculate using the formula (in mm):</p> <div style="border: 1px solid gray; padding: 5px; margin: 10px 0;"> <math display="block">C = 8 \times (d - 14)</math> </div> <p>where <math>d</math> is the resolution of the light curtain (for <math>d \leq 40</math> mm), or use 850 mm for C.</p>

Table 6. Depth Penetration Factor (D<sub>pf</sub>)

14 mm Systems	30 mm Systems
24 mm (0.94 in)	78 mm (3.1 in)

**Notes:**

1. The OSHA-recommended hand speed constant **K** has been determined by various studies and, although these studies indicate speeds of 1600 mm/sec. (63 in/sec.) to more than 2500 mm/sec. (100 in/sec.), they are not conclusive determinations. Consider all factors, including the physical ability of the operator, when determining the value of **K** to be used.
2. The recommended hand speed constant **K**, derived from data on approach speeds of the body or parts of the body as stated in ISO 13855.
3. **T<sub>s</sub>** is usually measured by a stop-time measuring device. If the machine manufacturer's specified stop time is used, at least 20% should be added to allow for possible clutch/ brake system deterioration. This measurement must take into account the slower of the two MPCE channels, and the response time of all devices or controls that react to stop the machine.

**WARNING:**



- **Stop time (T<sub>s</sub>) must include the response time of all devices or controls that react to stop the machine**
- If all devices are not included, the calculated safety distance (D<sub>s</sub> or S) will be too short, which can lead to serious injury or death.
- Include the stop time of all relevant devices and controls in your calculations.
- If required, each of the two machine primary control elements (MPCE1 and MPCE2) must be capable of immediately stopping the dangerous machine motion, regardless of the state of the other. These two channels of machine control need not be identical, but the stop time performance of the machine (T<sub>s</sub>, used to calculate the safety distance) must take into account the slower of the two channels.

## 5.2.2 Examples

### 5.2.3 U.S. Applications, Model S4BR30-600-S

<b>K</b>	=	63 inches per second (the hand speed constant set by OSHA)
<b>T<sub>s</sub></b>	=	0.31 (0.250 second is specified by the machine manufacturer; plus 20% safety factor; plus 13 ms for XS26-2 Safety Controller response time)
<b>T<sub>r</sub></b>	=	0.010 seconds (the specified response time of a S4BR30-600-S System)
<b>D<sub>pf</sub></b>	=	3.1 inches (30 mm resolution)
Substitute the numbers into the formula as follows:		
$D_s = K \times ( T_s + T_r ) + D_{pf}$		
$D_s = 63 \times (0.31 + 0.010) + 3.1 = 23.3 \text{ in}$		
Mount the S4B emitter and receiver so that no part of the defined area will be closer than 23.3 inches to the closest reachable hazard point on the guarded machine.		

### 5.2.4 European Applications, Model S4BR30-600-S

<b>K</b>	=	1600 mm per second
<b>T</b>	=	0.32 (0.250 second specified by machine manufacturer; plus 20% safety factor; plus 13 ms XS26-2 Safety Controller response time), plus 0.010 seconds (the specified response time of a S4BR30-600-S System)
<b>C</b>	=	$8 \times (30 - 14) = 128 \text{ mm}$ (30 mm resolution)
Substitute the numbers into the formula as follows:		
$S = (K \times T) + C$		
$S = (1600 \times 0.32) + 128 = 640 \text{ mm}$		
Mount the S4B emitter and receiver so that no part of the defined area will be closer than 640 mm to the closest reachable hazard point on the guarded machine.		

## 5.3 Reducing or Eliminating Pass-Through Hazards

A *pass-through* hazard is associated with applications where personnel may pass through a safeguard, such as the S4B Safety Light Curtain (which issues a stop command to remove the hazard), and then continues into the guarded area. This is common in access and perimeter guarding applications. Subsequently, their presence is no longer detected, and the related danger becomes the unexpected start or restart of the machine while personnel are within the guarded area.

In the use of light curtains, a pass-through hazard typically results from large safety distances calculated from long stopping times, large minimum object sensitivities, reach-over, reach-through, or other installation considerations. A pass-through hazard can be generated with as little as 75 mm (3 in) between the sensing field and the machine frame or hard (fixed) guarding.

Eliminate or reduce pass-through hazards whenever possible. While it is recommended to eliminate the pass-through hazard altogether, this may not be possible due to machine layout, machine capabilities, or other application considerations.

One solution is to ensure that personnel are continually sensed while within the hazardous area. This can be accomplished by using supplemental safeguarding, such as described by the safety requirements in ANSI B11.19 or other appropriate standards.

An alternative method is to ensure that after the safeguarding device is tripped, the corresponding safety monitoring device latches and requires a deliberate manual action to reset. This method of safeguarding relies upon the location of the reset switch as well as safe work practices and procedures to prevent an unexpected start or restart of the guarded machine. The

S4B Safety Light Curtain does not provide a configurable Manual Start/Restart (Latch Output) function. For these applications, this function must be implemented in the external safety monitoring device.

**WARNING:**



- **Use of the Banner device for Access or Perimeter Guarding**
- Failure to observe this warning could result in serious injury or death.
- If a Banner device is installed in an application that results in a pass-through hazard (for example, perimeter guarding), either the Banner device System or the Machine Primary Control Elements (MPCEs) of the guarded machine must cause a Latched (manual reset) response following an interruption of the defined area. The reset of this Latched (manual reset) condition may only be achieved by actuating a reset switch that is separate from the normal means of machine cycle initiation. Lockout/Tagout procedures per ANSI Z244.1 may be required, or additional safeguarding, as described by ANSI B11.19 safety requirements or other appropriate standards, must be used if a passthrough hazard can not be eliminated or reduced to an acceptable level of risk.

## 5.4 Supplemental Safeguarding

As described in "[Calculating the Safety Distance \(Minimum Distance\)](#)" on [page 20](#), position the S4B such that an individual cannot reach through the defined area and access the hazard point before the machine has stopped.


Additionally, the hazard cannot be accessible by reaching around, under, or over the defined area. To accomplish this, supplemental guarding (mechanical barriers, such as screens or bars), as described by ANSI B11.19 safety requirements or other appropriate standards, must be installed. Access will then be possible only through the defined area of the S4B System or through other safeguarding that prevents access to the hazard.

The mechanical barriers used for this purpose are typically called "hard (fixed) guarding"; there must be no gaps between the hard (fixed) guarding and the defined area. Any openings in the hard (fixed) guarding must comply with the safe opening requirements of ANSI B11.19 or other appropriate standard.

"[Figure: An example of supplemental safeguarding](#)" on [page 23](#) shows an example of supplemental safeguarding inside a robotic work cell. The S4B, in conjunction with the

hard (fixed) guarding, is the primary safeguard. Supplemental safeguarding (such as a horizontal-mounted safety light curtain as an area guard) is required in areas that cannot be viewed from the reset switch (for example, behind the robot and the conveyor). Additional supplemental safeguarding may be required to prevent clearance or trapping hazards (for example, a safety mat as an area guard between the robot, the turntable, and the conveyor).

Figure 5. An example of supplemental safeguarding

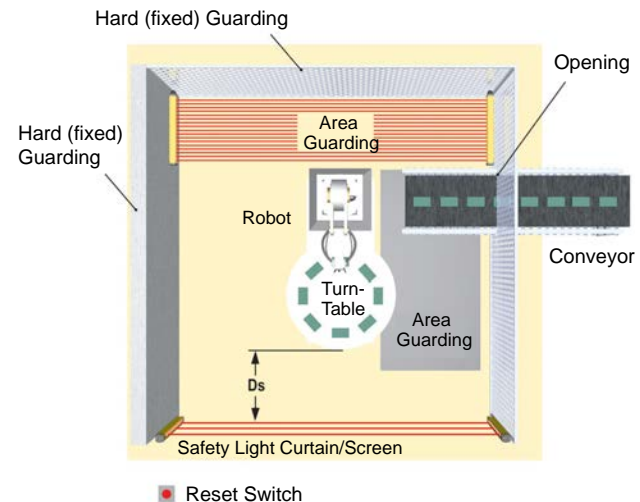

**WARNING:**



- **The hazard must be accessible only through the sensing field**
- Incorrect system installation could result in serious injury or death.
- The installation of the S4B must prevent any individual from reaching around, under, over or through the defined area and into the hazard without being detected.
- See OSHA CFR 1910.217, ANSI B11.19, and/or ISO 14119, ISO 14120 and ISO 13857 for information on determining safety distances and safe opening sizes for your guarding device. Mechanical barriers (for example, hard (fixed) guarding) or supplemental safeguarding might be required to comply with these requirements.



## 5.5 Reset Switch Location

The S4B has a trip output (auto power-up and automatic reset) that turns the OSSD outputs ON when the defined area is unobstructed (clear). Per application requirements, a latch response requiring a manual reset to a power-up condition or after an interruption has cleared the defined area might be required. The latch function can be provided by interfacing the S4B OSSD outputs to the machine's safety-related control system, a safety controller (such as SC10-2roe or XS/SC26-2), or safety module (such as the UM-FA-9A/11A).

The system or device providing the latch/reset function must conform to the level of performance required by the risk assessment. In applications requiring Control Reliability and/or ISO 13849-1:2015 Categories 3 or 4 and PL d or e, it is recommended that a monitored manual reset (for example, open-closed-open action), such that a shorted or tied-down button cannot cause a reset, be used.

**The reset switch must be mounted at a location that complies with the warning and guidelines below.** If any hazardous areas are not in view from the switch location, additional means of safeguarding must be provided. The switch should be protected from accidental or unintended actuation (for example, through the use of rings or guards).

A key-actuated reset switch provides some operator or supervisory control, as the key can be removed from the switch and taken into the guarded area. However, this does not prevent unauthorized or inadvertent resets due to spare keys in the possession of others, or additional personnel entering the guarded area unnoticed. When considering where to locate the reset switch, follow the guidelines below.

### WARNING:



- **Install reset switches properly**
- Failure to properly install reset switches could result in serious injury or death.
- Install reset switches so that they are accessible only from outside, and in full view of, the safeguarded space. Reset switches cannot be accessible from within the safeguarded space. Protect reset switches against unauthorized or inadvertent operation (for example, through the use of rings or guards). If there are any hazardous areas that are not visible from the reset switches, provide additional safeguarding.

All reset switches must be:

- Outside the guarded area
- Located to allow the switch operator a full, unobstructed, view of the entire guarded area while the reset is performed
- Out of reach from within the guarded area
- Protected against unauthorized or inadvertent operation (such as through the use of rings or guards)

**IMPORTANT:** Resetting a safeguard must not initiate hazardous motion. Safe work procedures require a start-up procedure to be followed and the individual performing the reset to verify that the entire hazardous area is clear of all personnel before each reset of the safeguard is performed. If any area cannot be observed from the reset switch location, additional supplemental safeguarding must be used: at a minimum, visual and audible warnings of machine start-up.



## 5.6 Other Considerations

### 5.6.1 Adjacent Reflective Surfaces

A reflective surface located adjacent to the defined area may deflect one or more beams around an object in the defined area. In the worst case, an optical short circuit may occur, allowing an object to pass undetected through the defined area.

**WARNING:**



- Do not install the system near reflective surfaces
- Reflective surfaces could reflect the sensing beam(s) around an object or person within the defined area, preventing detection by the system. Failure to prevent reflection problems results in incomplete guarding and an optical short circuit that could result in serious injury or death.
- Do not locate the defined area near a reflective surface. Perform the trip test, as described in the product documentation, to detect such reflection(s).

This reflective surface may result from shiny surfaces or glossy paint on the machine, the workpiece, the work surface, the floor, or the walls. Beams deflected by reflective surfaces are discovered by performing the trip test and the periodic checkout procedures. To eliminate problem reflections:

- If possible, relocate the sensors to move the beams away from the reflective surface(s) (see "[Figure: Adjacent Reflective Surfaces](#)" on page 25), being careful to maintain adequate Safety Distance (Minimum Distance)
- Otherwise, if possible, paint, mask, or roughen the shiny surface to reduce its reflectivity
- Where these are not possible (as with a shiny workpiece or machine frame), determine the worst-case resolution (see "[Figure: Determining Worst-Case Resolution With Larger Test Piece](#)" on page 25) resulting from the optical short circuit and use the corresponding depth penetration factor ( $D_{pf}$  or C) in the Safety Distance (Minimum Distance) formula (see "[Calculating the Safety Distance \(Minimum Distance\)](#)" on page 20); or mount the sensors in such a way that the receiver's field of view and/or the emitter's spread of light are restricted from the reflective surface
- Repeat the trip test (see "[Conduct a Trip Test](#)" on page 38) to verify these changes have eliminated the problem reflection(s). If the workpiece is especially reflective and comes close to the defined area, perform the trip test with the workpiece in place

Figure 6. Adjacent Reflective Surfaces


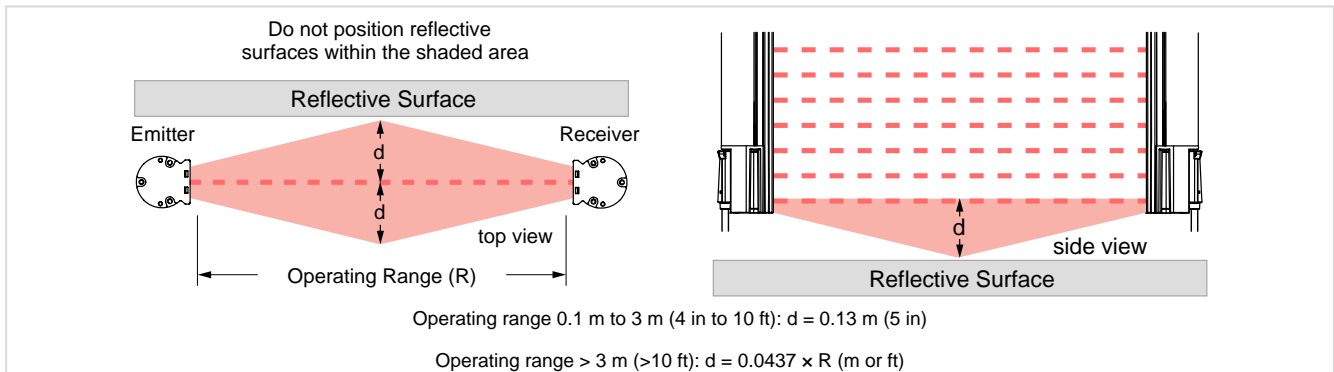


Figure 7. Determining Worst-Case Resolution With Larger Test Piece

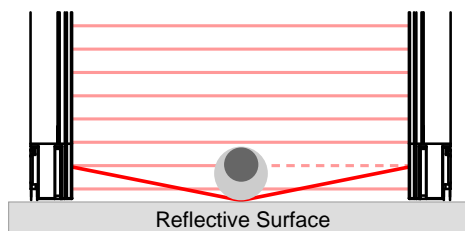

If an optical short circuit exists due to a reflective adjacent surface, a test piece (represented by the dark gray circle) with the specified system resolution will not cause a blocked condition. In this situation, during the trip test, the Zone indicators and Status indicator will be green and the OSSDs will be on.

To determine the worst-case resolution, select larger test pieces (represented by the light gray circle) and perform a trip test. The midpoint between the emitter and receiver may cause the most optical short circuits. The test piece that passes the trip test determines the worst-case resolution for this installation. Use the table below to calculate a new depth penetration factor  $D_{pf}$  or Factor "C".

Test Piece Model	Resolution	Depth Penetration Factor for U.S. Applications	Factor "C" for European Applications
STP-13	14 mm	24 mm (1 in)	0 mm
STP-2	19 mm	41 mm (1.6 in)	40 mm (1.6 in)
STP-16	25 mm	61 mm (2.5 in)	88 mm (3.5 in)
STP-14	30 mm	78 mm (3.1 in)	128 mm (5 in)
STP-4	32 mm	85 mm (3.3 in)	144 mm (5.7 in)
STP-17	34 mm	92 mm (3.6 in)	160 mm (6.3 in)
STP-1	38 mm	106 mm (4.2 in)	192 mm (7.6 in)
STP-3	45 mm	129 mm (5 in)	850 mm (33.5 in)
STP-8	51 mm	150 mm (5.9 in)	850 mm (33.5 in)
STP-5	58 mm	173 mm (6.8 in)	850 mm (33.5 in)
STP-15	60 mm	180 mm (7 in)	850 mm (33.5 in)
STP-12	62 mm	187 mm (7.4 in)	850 mm (33.5 in)

### 5.6.2 Use of Corner Mirrors

S4B may be used with one or more corner mirrors. Mirrors are not allowed for applications that would allow undetected personnel access into the safeguarded area.

The use of glass-surface corner mirrors reduces the maximum specified emitter/receiver separation by approximately 8 percent per mirror, as follows:

Table 7. Light Curtain Maximum Range

Light Curtain Series	0 Mirrors	1 Mirror	2 Mirrors	3 Mirrors	4 Mirrors
SLC4 Safety Light Curtain	2 m (6.6 ft)	1.8 m (5.9 ft)	1.6 m (5.2 ft)	1.5 m (4.9 ft)	1.4 m (4.6 ft)
EZ-SCREEN® LP Basic (SLPVA)	4 m (13 ft)	3.7 m (12.1 ft)	3.4 m (11.2 ft)	3.1 ft m (10.3 ft)	2.8 m (9.2 ft)
14 mm EZ-SCREEN® (SLS)	6 m (20 ft)	5.6 m (18.4 ft)	5.2 m (17.0 ft)	4.8 m (15.7 ft)	4.4 m (14.5 ft)
EZ-SCREEN® LP (SLP)	7 m (23 ft)	6.5 m (21.2 ft)	6.0 m (19.5 ft)	5.5 m (18.0 ft)	5.1 m (16.6 ft)
EZ-SCREEN® LS Basic (SLLV)	8 m (26.2 ft)	7.4 m (24.3 ft)	6.8 m (22.3 ft)	6.2 m (20.3 ft)	5.7 m (18.7 ft)
EZ-SCREEN® LS (SLL)	12 m (39 ft)	11 m (36 ft)	10.1 m (33 ft)	9.3 m (30.5 ft)	8.6 m (28 ft)
S4B Safety Light Curtain	12 m (39 ft)	11 m (36 ft)	10.1 m (33 ft)	9.3 m (30.5 ft)	8.6 m (28 ft)
EZ-SCREEN® Type 2 (LS2)	15 m (50 ft)	13.8 m (45 ft)	12.7 m (42 ft)	11.7 m (38 ft)	10.8 m (35 ft)
30 mm EZ-SCREEN® (SLS)	18 m (60 ft)	16.8 m (55 ft)	15.5 m (51 ft)	14.3 m (47 ft)	13.1 m (43 ft)

See the specific mirror datasheet or [www.bannerengineering.com](http://www.bannerengineering.com) for more information.


If mirrors are used, the difference between the angle of incidence from the emitter to the mirror and from the mirror to the receiver must be between 45° and 120°. If placed at a sharper angle, an object in the light curtain may deflect beam(s) to the receiver, preventing the object from being detected, also know as false proxing. Angles greater than 120° result in difficult alignment and possible optical short circuits.

**WARNING:**



- **Retroreflective Mode Installation**
- Failure to follow these instructions may create unreliable sensing and may result in serious injury or death.
- Do not install emitters and receivers in retroreflective mode with less than a 45° angle of incidence. Install emitters and receivers at an appropriate angle.

Figure 8. Using S4B sensors in a retroreflective mode

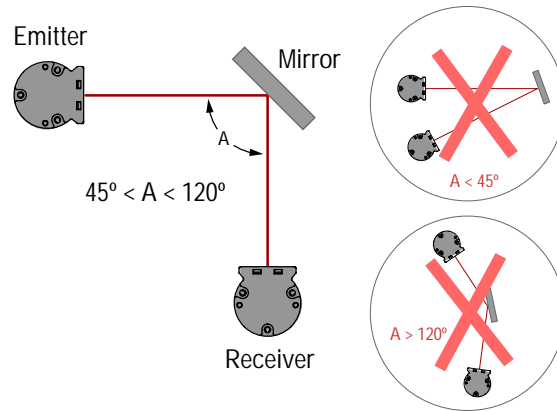

### 5.6.3 Emitter and Receiver Orientation

The emitter and receiver must be mounted parallel to each other and aligned in a common plane, with both machine interface cable ends pointing in the same direction.

Never mount the emitter with its machine interface cable end oriented in the opposite direction of the cable end of the receiver. If this occurs, voids in the light curtain may allow objects or personnel to pass through the defined area undetected.

The emitter and receiver may be oriented in a vertical or horizontal plane, or at any angle between horizontal and vertical, as long as they are parallel to each other and their cable ends point in the same direction. Verify that the light curtain completely covers all access to the hazard point that is not already protected by hard (fixed) guarding or other supplemental guarding.

**WARNING:**



- Properly install system components
- Incorrectly orienting the system components impairs the performance of the system and results in incomplete guarding, which can result in serious injury or death.
- Install the system components with their corresponding cable ends pointing in the same direction.

Figure 9. Examples of Correct Emitter/Receiver Orientation


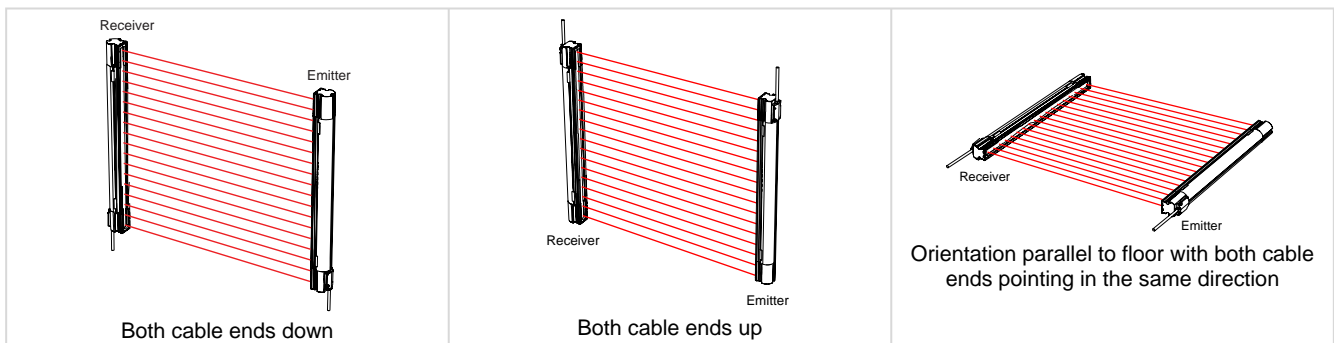


Figure 10. Examples of Incorrect Emitter/Receiver Orientation

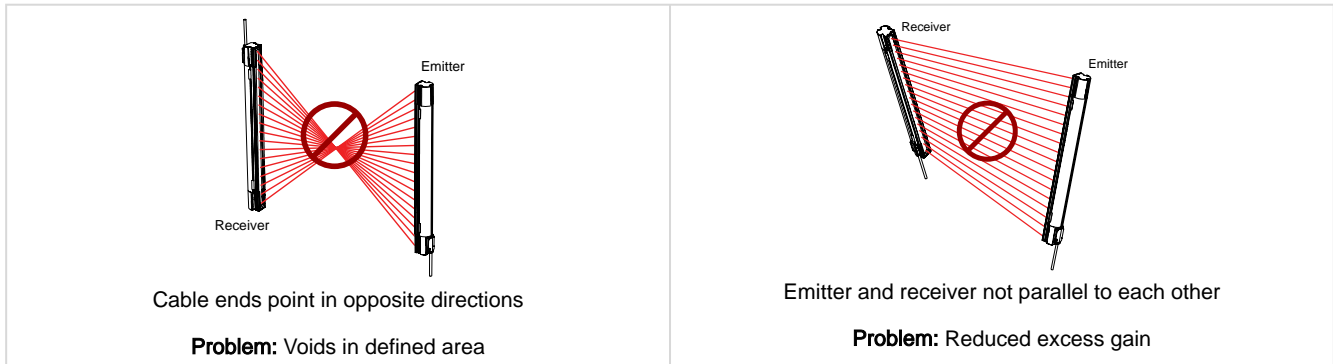


### 5.6.4 Installation of Multiple Systems

Whenever two or more S4B emitter and receiver pairs are adjacent to one another, optical crosstalk may take place between the systems.

To minimize optical crosstalk, alternate the positions of the emitters and receivers as shown in "Figure: Installation of Multiple Systems" on page 29, or alternate scan codes.

When three or more systems are installed in the same plane, optical crosstalk may occur between sensor pairs whose emitter and receiver lenses are oriented in the same direction. In this situation, eliminate optical crosstalk by mounting these sensor pairs exactly in line with each other within one plane, or by adding a mechanical barrier between the pairs as shown in "Figure: Installation of Multiple Systems" on page 29.

Figure 11. Optical Crosstalk

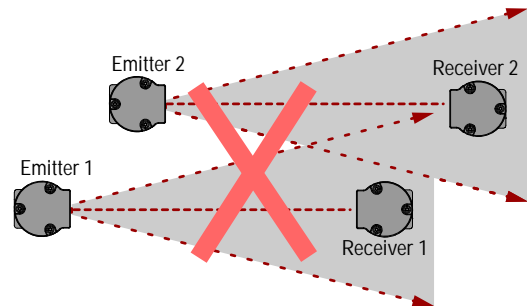

#### WARNING:




- **Adjacent components can synchronize incorrectly**
- The light curtain's safety function is reduced when components are not synchronized correctly, creating an unsafe condition that could result in serious injury or death.
- When multiple systems are mounted closely together, or where a secondary emitter is in view (within  $\pm 5^\circ$ ) and within range of an adjacent receiver, a receiver can synchronize to the signal from the wrong emitter, reducing the safety function of the light curtain.

To further aid in avoiding crosstalk, the sensors feature two selectable scan codes. A receiver set to one scan code will not respond to an emitter set to another code. The emitter and receiver within a system must be set to the same scan code.

Scan codes are set via the switches in the RD cordsets on the emitters and receivers. See "Scan Code Selection" on page 34 for the switch settings.

Figure 12. Installation of Multiple Systems

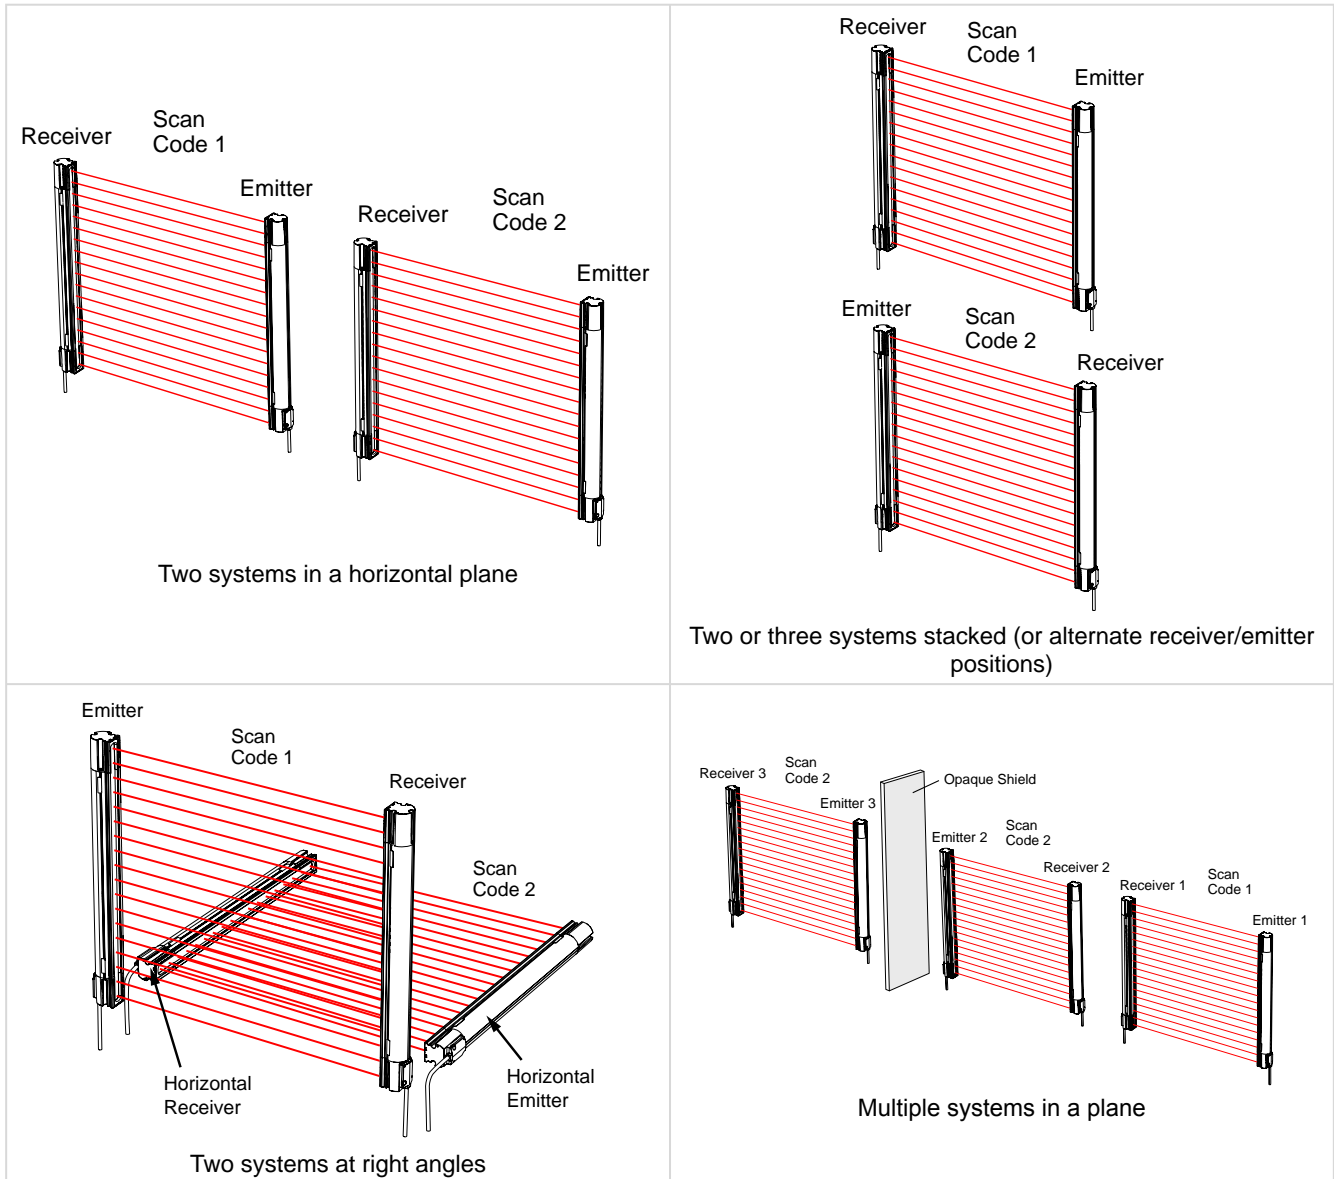

**WARNING:**



- **Properly connect multiple pairs of sensors**
- Connecting multiple output signal switching devices (OSSD) safety outputs to one interface module or otherwise parallel OSSD outputs can result in serious bodily injury or death, and is prohibited.
- Do not connect multiple pairs of sensors to a single device.

**WARNING:**



- **Use different scan codes**
- If you do not use different scan codes, a receiver can synchronize to the signal from the wrong emitter, reducing the safety function of the light curtain and creating an unsafe condition that could result in serious injury or death.
- Configure adjacent systems to use different scan codes (for example, set one system to use scan code 1 and the other system to use scan code 2). Perform a trip test to confirm the light curtain function.

## 5.7 Mounting System Components

### 5.7.1 Mounting Hardware


After the mechanical layout considerations are addressed, mount the sensors and route the cables.

All brackets are ordered separately; no brackets are shipped with the sensors. The quantity of brackets ordered and the placement of those brackets must ensure the unsupported distance (distance between brackets) is less than 900 mm (35.4 in).

#### Mounting the S4BA-MBK-16 Side-Mount Bracket

The S4BA-MBK-16 brackets are ordered separately. Two brackets are included in each kit.

Figure 13. Side-Mount Bracket

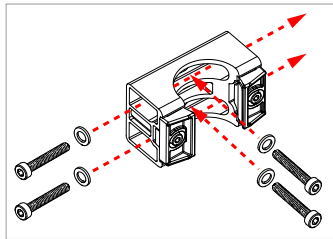

- See "[Sensor Mounting and Mechanical Alignment Verification](#)" on page 32 for additional mounting recommendations
- The machine interface connector ends of both sensors must point in the same direction
- The sensors are designed to be mounted with up to 900 mm (35.4 in) of unsupported distance between brackets when they are subject to shock or vibration

**NOTE:** Note: It is best to place brackets near the ends of each sensor (not on end caps). Add additional brackets per sensor as needed to meet 900 mm unsupported distance requirement. This means that 300 mm to 900 mm sensors can use two brackets per sensor, while 1050 mm to 1800 mm sensors should use three brackets per sensor.

- See "[Brackets](#)" on page 67 for mounting bracket dimensions
- The M4 bolts, washers, and nuts are user-supplied

**NOTE:** Use washers under the screw heads to minimize bracket damage.

1. From a common point of reference (ensuring the calculated minimum safety distance), measure to position the emitter and receiver in the same plane, with their midpoints directly opposite each other.  
The connector ends of both sensors must point in the same direction (see "[Emitter and Receiver Orientation](#)" on page 27).
2. Mount the emitter and receiver side brackets to the desired surface with user-supplied M4 bolts, washers, and nuts. Tighten to 2.15 N·m (19 in·lbs).
3. Loosen the M4 clamp screws on the side brackets enough to easily insert a sensor.
4. Insert each sensor in to its respective brackets with the front window facing out of the opening in the front of the bracket.

**NOTE:** The sensors need to lightly snap into the brackets. If the sensors will not install easily, loosen the M4 clamp screws to allow the clamps to slide out of the way of the sensor.


5. Position the emitter and receiver windows directly facing each other.

6. Measure from a reference plane, for example, a level building floor, to the same point(s) on the emitter and receiver to verify their mechanical alignment. Use a carpenter's level, a plumb bob, or the optional LAT-1 Laser Alignment Tool (see "[Alignment Aids](#)" on page 72) or check the diagonal distances between the sensors, to achieve mechanical alignment. See "[Sensor Mounting and Mechanical Alignment Verification](#)" on page 32.
7. Temporarily tighten all fasteners that allow for adjustment. Final alignment procedures are explained in "[Initial Checkout Procedure](#)" on page 35.
8. After the emitter and receiver alignment is completed, tighten the bracket front M4 clamp screws to 2.15 N·m (19 in·lbs).

**NOTE:** Each bracket has two clamp screws. Both clamp screws on every bracket need to be fully tightened to provide sufficient strength to hold the sensor. Do not reposition the sensor when the clamps are mostly or fully tightened. Doing so could damage clamp pads.

## Mounting the S4BA-MBK-11 End-Mount Brackets

The S4BA-MBK-11 brackets are ordered separately. Two brackets are included in each kit.

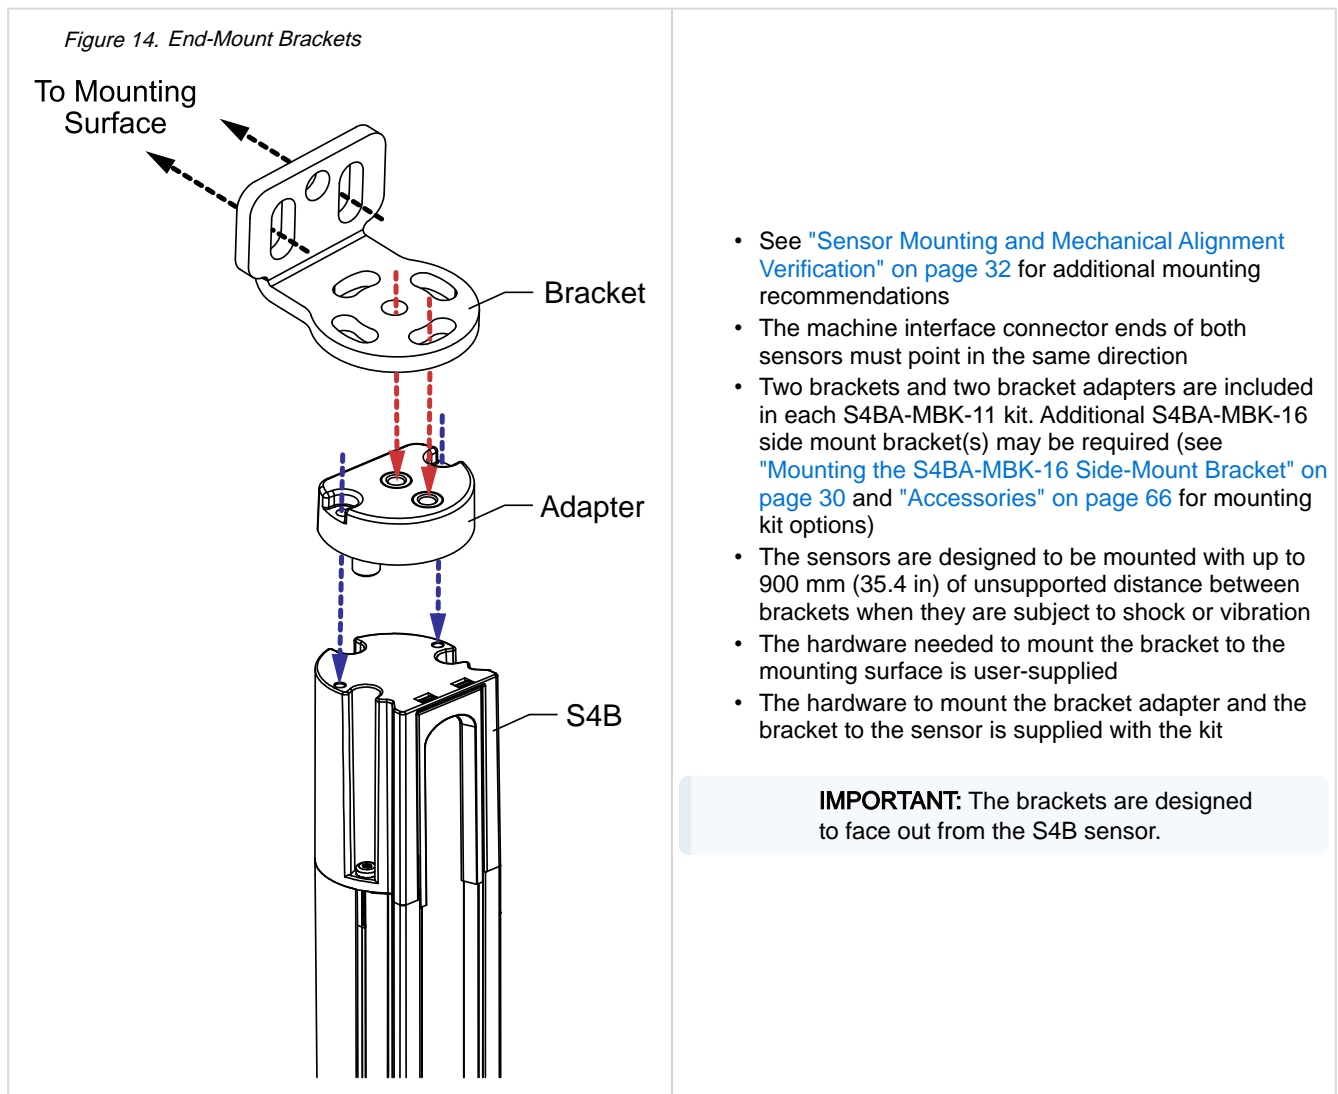

1. Attach an adapter to each end of the sensor using the supplied M3 washers and screws. Tighten to 8 in-lbs.
2. Attach a bracket to each adapter using the supplied M5 screws. Loosely tighten the screws at this time.
3. From a common point of reference (ensuring the calculated minimum safety distance), measure to position the emitter and receiver in the same plane, with their midpoints directly opposite each other. Locate and drill mounting holes, if necessary.





4. Position the emitter and receiver in their brackets, as shown in "Emitter and Receiver Orientation" on page 27. Loosely attach the brackets to the mounting surface.
5. Verify that the sensor windows directly face each other. Measure from a reference plane, for example, a level building floor, to the same point(s) on the emitter and receiver to verify their mechanical alignment. Use a carpenter's level, a plumb bob, or the optional LAT-1 Laser Alignment Tool (see "Alignment Aids" on page 72) or check the diagonal distances between the sensors, to achieve mechanical alignment. Final alignment procedures are explained in "Initial Checkout Procedure" on page 35.
6. After the emitter and receiver alignment is completed, tighten the screws connecting the brackets to the adapter. Tighten to 36 in-lbs.
7. Tighten the fasteners holding the bracket to the mounting surface.

## 5.7.2 Sensor Mounting and Mechanical Alignment Verification

### Verify that:


- The emitter and receiver are directly opposite each other
- Nothing is interrupting the defined area
- The defined area is the same distance from a common reference plane for each sensor
- The emitter and receiver are in the same plane and are level/plumb and square to each other (vertical, horizontal, or inclined at the same angle, and not tilted front-to-back or side-to-side)

Figure 15. Incorrect Sensor Alignment

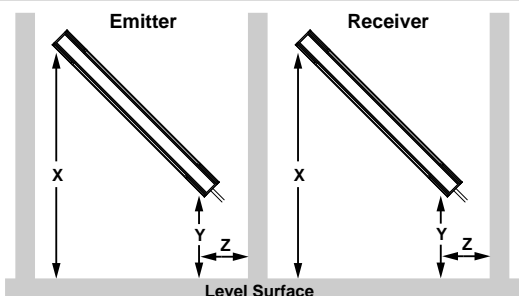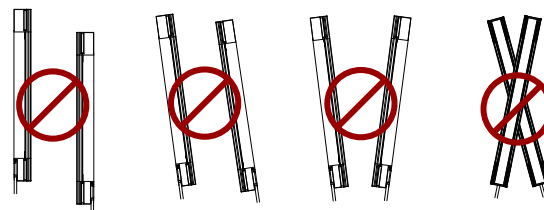

### Angled or Horizontal Installations – verify that:

- Distance X at the emitter and receiver are equal
- Distance Y at the emitter and receiver are equal
- Distance Z at the emitter and receiver are equal from parallel surfaces
- Vertical face (the window) is level/plumb
- Defined area is square. Check diagonal measurements if possible; see Vertical Installations, on the right.

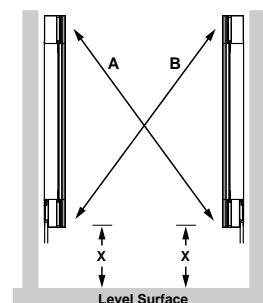

### Vertical Installations – verify that:

- Distance X at the emitter and receiver are equal
- Both sensors are level/plumb (check both the side and face)
- Defined area is square. Check diagonal measurements if possible (Diagonal A = Diagonal B).



## Chapter Contents

6.1 Routing Cordsets.....	33
6.2 Scan Code Selection.....	34
6.3 Initial Electrical Connections .....	35
6.4 Initial Checkout Procedure .....	35
6.5 Electrical Connections to the Guarded Machine .....	40
6.6 Wiring Diagrams.....	46

## Chapter 6 Electrical Installation and Testing

The following are the main steps to electrically install the S4B components and interface with the guarded machine.

**WARNING:**

- **Read this Section Carefully Before Installing the System**
- **Failure to follow these instructions could result in serious injury or death.**
- If all mounting, installation, interfacing, and checkout procedures are not followed properly, this Banner device cannot provide the protection for which it was designed.
- The user is responsible for ensuring that all local, state, and national laws, rules, codes, or regulations relating to the installation and use of this control system in any particular application are satisfied. Ensure that all legal requirements have been met and that all technical installation and maintenance instructions contained in this manual are followed.
- The user has the sole responsibility to ensure that this Banner device is installed and interfaced to the guarded machine by Qualified Persons, in accordance with this manual and applicable safety regulations. A Qualified person is a person who, by possession of a recognized degree or certificate of professional training, or who, by extensive knowledge, training and experience, has successfully demonstrated the ability to solve problems relating to the subject matter and work.

1. Routing cordsets and making initial electrical connections (see "[Routing Cordsets](#)" on page 33 and "[Initial Electrical Connections](#)" on page 35).
2. Apply power to each emitter/receiver pair (see "[Initial Electrical Connections](#)" on page 35).
3. Perform an Initial Checkout Procedure (see "[Initial Checkout Procedure](#)" on page 35).
4. Make all electrical interface connections to the guarded machine (see "[Electrical Connections to the Guarded Machine](#)" on page 40).
5. Perform a Commissioning Checkout Procedure (see "[Commissioning Checkout](#)" on page 44).

### 6.1 Routing Cordsets

Attach the required cordsets to the sensors, and route the sensor cables to the junction box, electrical panel, or other enclosure in which the other safety-related parts of the control system are located. This must be done per local wiring code for low-voltage DC control cables and may require the installation of electrical conduit.

See "[Accessories](#)" on page 66 for selection of cables.

The S4B is designed and manufactured to be highly resistant to electrical noise and to operate reliably in industrial settings. However, extreme electrical noise may cause a random Trip condition; in extreme cases, a Lockout is possible.

Emitter and receiver wiring is low voltage; routing the sensor wires alongside power wires, motor/servo wires, or other high voltage wiring may inject noise into the S4B System. It is good wiring practice, and sometimes may be required by code, to isolate emitter and receiver cables from high-voltage wires and to avoid routing cables close to sources of noise.

Sensor cabling and any interconnect wiring should have an insulation temperature rating of at least 90 °C (194 °F).

See "[Maximum machine interface cable length versus total load current \(OSSDs\)](#)" on page 59 for more information.

## 6.2 Scan Code Selection

The emitter and receiver may be configured to one of two scan codes (1 or 2).

A receiver recognizes light only from an emitter with the same scan code. Both the emitter and its corresponding receiver must have the same scan code setting. The scan code must be configured with power off because the removeable disconnect cordset assemblies must be removed from the units. See "[Accessories](#)" on page 66 for options.

In a cascade system the scan codes automatically alternate. If the host is set at scan code 1, the first remote (second unit) will be scan code 2, the second remote (third unit) will be scan code 1, and the third remote (fourth unit) will be scan code 2.


The default scan code setting is scan code 1.

To change the scan code setting, use the following instructions.

1. Remove the removeable disconnect cordset assembly from the sensor by loosening the two or four screws (#1 Phillips drive), depending on the model.


**NOTE:** The screws are captive screws and should not be removed from the cordset assembly.

Figure 16. Remove the Cordset

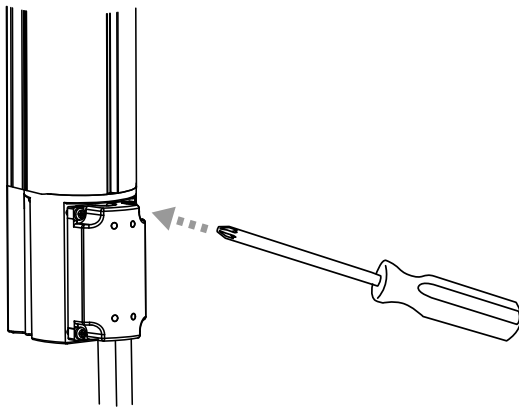

2. Flip the cordset over to see the two switches.

Figure 17. Scan Code Switches

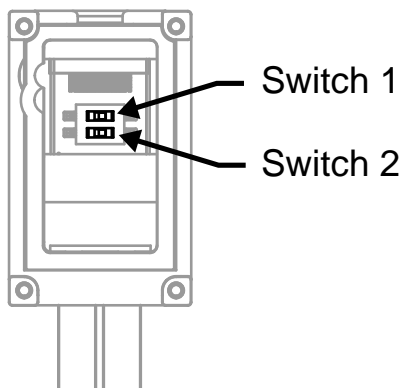

Scan Code 1: Switch 1 (top switch) in the left position

Scan Code 2: Switch 1 (top switch) in the right position

3. Position the cordset onto the sensor.
4. Hand tighten the two or four screws.

## 6.3 Initial Electrical Connections

### WARNING:



- **Risk of electric shock**
- Use extreme caution to avoid electrical shock. Serious injury or death could result.
- Always disconnect power from the safety system (for example, device, module, interfacing, etc.), guarded machine, and/or the machine being controlled before making any connections or replacing any component. Lockout/tagout procedures might be required. Refer to OSHA 29CFR1910.147, ANSI Z244-1, or the applicable standard for controlling hazardous energy.
- Make no more connections to the device or system than are described in this manual. Electrical installation and wiring must be made by a Qualified Person<sup>(1)</sup> and must comply with the applicable electrical standards and wiring codes, such as the NEC (National Electrical Code), NFPA 79, or IEC 60204-1, and all applicable local standards and codes.

Lockout/tagout procedures may be required (refer to OSHA1910.147, ANSI Z244-1, ISO 14118, or the appropriate standard for controlling hazardous energy).

Make the electrical connections in the order described in this section. Do not remove end-caps; no internal connections are to be made. All connections are made through the RD cordset connection.

### Emitter Cordset

S4B emitters require a mating 5-pin or 8-pin cordset, but not all conductors are used. The other wires are in place to allow a parallel connection (color-for-color) to the receiver cable, providing sensor interchangeability (or “swapability”); either sensor may be installed at either cordset connection. In addition to providing similar cabling, this wiring scheme is advantageous during installation, wiring, and troubleshooting.

### 5-pin Receiver Cordset

**Do not connect any wires to the machine control circuits (OSSD outputs) at this time.**

### 8-pin Receiver Cordset

**Do not connect any wires to the machine control circuits (OSSD outputs) at this time.** For the initial power-up and checkout, External Device Monitoring (EDM) must be configured/wired (see ["External Device Monitoring" on page 42](#)). Take precautions to prevent unused wires from shorting to ground or to other sources of energy (for example, terminate with a wire-nut). Final OSSD wiring must be completed later.

## 6.4 Initial Checkout Procedure

The initial checkout procedure must be performed by a Qualified Person. It must be performed only after configuring the System and after connecting the components.

Perform this procedure to:

- Ensure proper installation when the System is first installed
- Ensure proper System function whenever any maintenance or modification is performed on the System or on the machinery that is guarded by the System.

### 6.4.1 Configuring the System for Initial Checkout

For the initial checkout, the S4B System must be checked without power available to the guarded machine. Final interface connections to the guarded machine cannot take place until the light curtain system has been checked out. This may require lockout/tagout procedures (refer to OSHA1910.147, ANSI Z244-1, ISO 14118, or the appropriate standard for controlling hazardous energy). The OSSD connections will be made after the initial checkout procedure has been successfully completed.

Verify that:

- Power has been removed from (or is not available to) the guarded machine and its controls or actuators
- The machine control circuit or the Safety/Interface Module is not connected to the OSSD outputs at this time (permanent connections will be made later)

<sup>(1)</sup> A person who, by possession of a recognized degree or certificate of professional training, or who, by extensive knowledge, training and experience, has successfully demonstrated the ability to solve problems relating to the subject matter and work.

- EDM is configured and wired per application requirements (1-channel or no monitoring, see ["External Device Monitoring" on page 42](#))

## 6.4.2 Apply Initial Power to the System

1. Inspect the area near the light curtain for reflective surfaces, including work pieces and the guarded machine. Reflective surfaces may cause light beams to reflect around a person in the light curtain, preventing the person from being detected and not stopping the machine motion (see ["Adjacent Reflective Surfaces" on page 25](#)).
2. Eliminate the reflective surfaces as much possible by relocating, painting, masking, or roughening them. Remaining problem reflections will become apparent during the trip test.
3. Verify that power is removed from the S4B System and from the guarded machine and that the OSSD safety outputs are not connected.
4. Remove all obstructions from the light curtain.
5. With the power to the guarded machine off, connect +24 V DC (brown wire) and 0 V DC (blue wire) on both the emitter and receiver cables to a SELV-rated power supply. Make external device monitoring (EDM) connections on both the emitter and receiver cables, if applicable. See ["Wiring Diagrams" on page 46](#).
6. Power up the S4B System only.
7. Verify that the input power is present to both the emitter and the receiver. At least one indicator on both the emitter and the receiver should be on and the start-up sequence should cycle.
8. Watch both the emitter and the receiver Status indicators and the receiver Zone indicators to determine the light curtain alignment status.
  - **Emitter Lockout Condition**—the emitter's red Status indicator is single-flashing and the receiver's red Status indicator is on. Proceed to ["Troubleshooting" on page 54](#) for diagnostic information.
  - **Receiver Lockout Condition** —the receiver Status indicator is single-flashing red. Proceed to ["Troubleshooting" on page 54](#) for diagnostic information.
  - **Normal Operating Mode** (emitter)—The green Status indicator is on.
  - **Clear (Run) Condition** (receiver)—The green Status indicator is on. All green Zone indicators are on.
  - **A Blocked Condition** (receiver)—The red Status indicator is on and one or more red Zone indicator(s) are on, identifying the location of the blocked beams. Proceed to ["Optically Align the System Components " on page 36](#).

**NOTE:** If beam 1 is blocked, Zone indicator 1 is red and all others are off. Beam 1 provides the synchronization signal.

See ["Operating Features " on page 14](#) for indicator and display information.

9. Proceed to ["Optically Align the System Components " on page 36](#).

## 6.4.3 Optically Align the System Components

To verify the optimal alignment, adjust the sensor rotation with the power on and follow these steps.


### WARNING:




- **Hazard exposure**
- Failure to follow these instructions could result in serious injury or death.
- Verify that no individuals are exposed to any hazard if the output signal switching device (OSSD) outputs turn on when the emitter and receiver become aligned.

Before beginning, verify the sensor mounting.


1. Verify that the emitter and the receiver are pointed squarely at each other. The sensor face must be perpendicular to the optical axis.

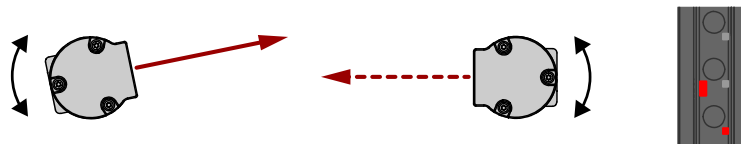

- If the Channel #1 beam is not aligned, the Status and Zone 1 indicators are red and Zone indicators 2–3 are off.
- If the green Status indicator is on, go to the next step. If not, rotate each sensor (one at a time) left and right until the green Status indicator is on. (As the sensor rotates out of alignment, the red Status indicator turns on). As more beams are aligned, the Zone indicators turn from red to green.

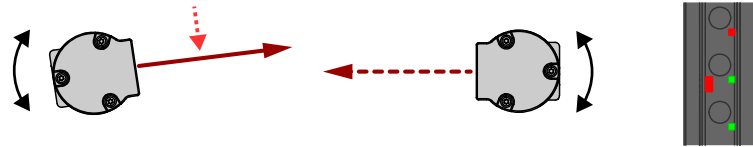


- Optimize alignment and maximize excess gain.

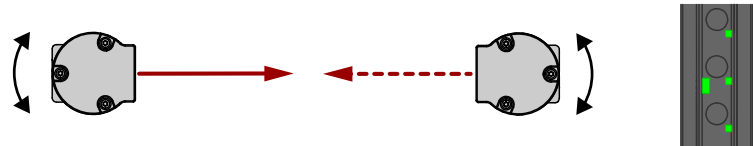

- Slightly loosen the sensor mounting screws.
- Rotate one sensor left and right, noting the positions in each arc where the Status indicators turn red (Blocked condition) or a zone indicator turns yellow (weak beam strength); repeat with the other sensor.
- Center each sensor between those two positions.
- Tighten the mounting screws, making sure to maintain the positioning as the screws are tightened.

If at any time the red Status indicator begins to flash, the System has entered a Lockout condition. See ["Troubleshooting" on page 54](#) for further information.

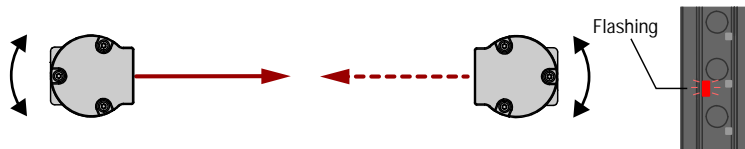


### 6.4.4 Optical Alignment Procedure with Mirrors

S4B sensors may be used with one or more corner mirrors for guarding more than one side of an area. The SSM-... rear-surface glass mirrors are rated at 85% efficiency. Thus, excess gain and sensing range are reduced when using mirrors; see Use of Corner Mirrors, under ["Mechanical Installation Considerations" on page 19](#).

During any adjustments, allow only one individual to adjust any one item at any one time.

In addition to the standard optical alignment procedure, verify:

- The emitter, receiver, and all mirrors are level and plumb.
- The middle of the defined area and the center point of the mirrors are approximately the same distance from a common reference point, such as the same height above a level floor.
- There are equal amounts of mirror surface above and below the defined area such that the optical beams are not passing below or above the mirror.

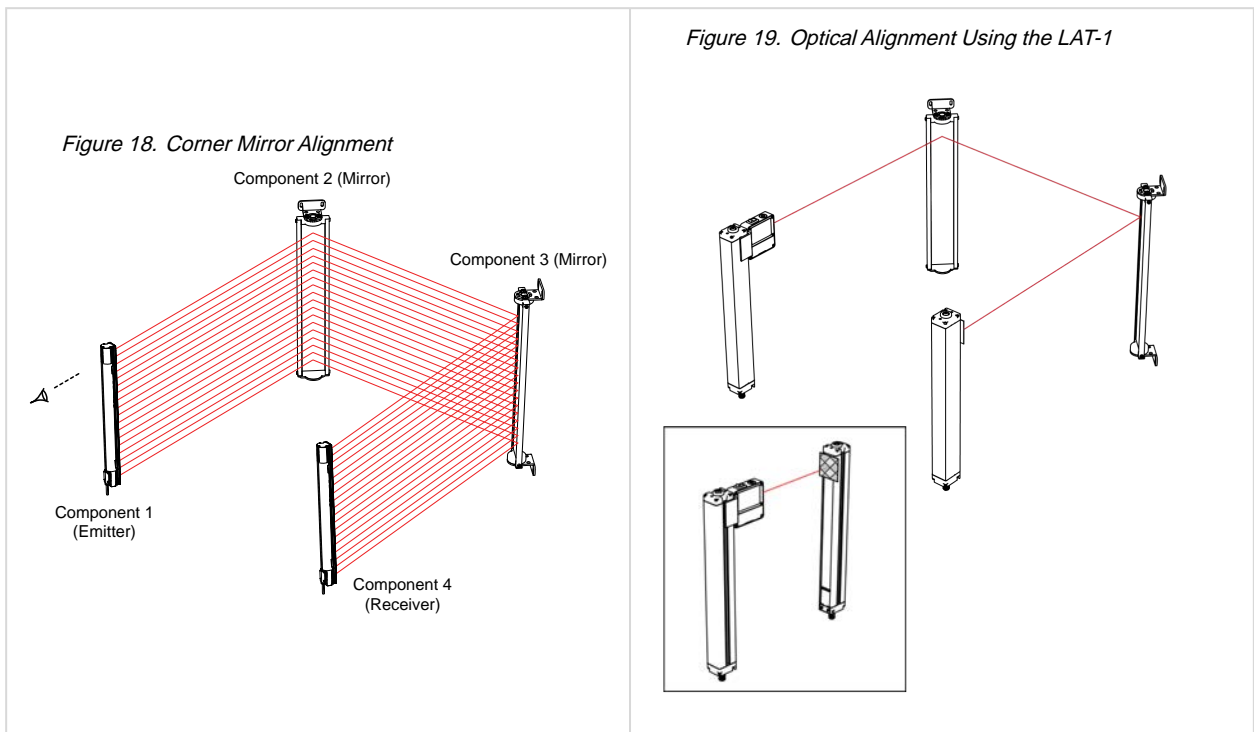


**NOTE:** An LAT-1 Laser Alignment Tool is very helpful by providing a visible red dot along the optical axis. See "[Alignment Aids](#)" on page 72 and Banner Safety Applications Note SA104 (p/n 57477) for more information.

### 6.4.5 Conduct a Trip Test

After optimizing the optical alignment and configuring fixed blanking and/or reduced resolution (if applicable), perform a trip test to verify the detection capability of the S4B System.

This test also verifies correct sensor orientation, identifies optical short circuits, and verifies the expected resolution for applications using reduced resolution. After the installation has passed the trip test, the safety outputs may be connected and the commissioning checkout may be performed (initial installations only).

1. Select the proper test piece, ordered separately.
  - For 14 mm resolution models: use the 14 mm (0.55 in) diameter model STP-13
  - For 30 mm resolution models: use the 30 mm (0.94 in ) diameter model STP-14
2. Verify that the System is in run mode, the green Status indicator is on, and all Zone indicators are green.
3. Pass the specified test piece through the defined area in three paths: near the emitter, near the receiver, and midway between the emitter and receiver.

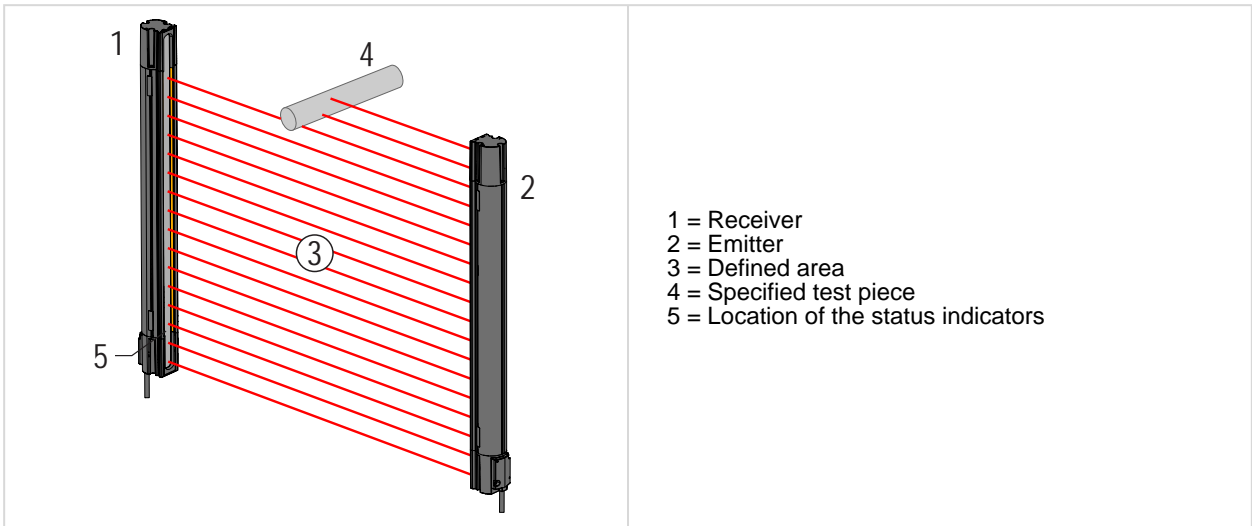

4. During each pass, while the test piece is interrupting the defined area, at least one Zone indicator must be red. The red Zone indicator must change with the position of the test piece within the defined area.

The Status indicator must turn red and remain red for as long as the test piece remains in the defined area. If not, the installation has failed the trip test.


If all Zone indicators turn green or fail to follow the position of the test piece while it is within the defined area, the installation has failed the trip test. Check for correct sensor orientation or reflective surfaces. Do not continue until the situation is corrected.

When the test piece is removed from the defined area, the green Status indicator must turn on.

**WARNING:**

- Trip test failure
- Using a system that has failed a trip test can result in serious bodily injury or death. If the trip test has failed, the system might not stop dangerous machine motion when a person or object enters the sensing field.
- Do not attempt to use the system if the system does not respond properly to the trip test.

5. If mirrors are used in the application: Test the defined area on each section of the sensing path (for example, emitter to mirror, between mirror and receiver).

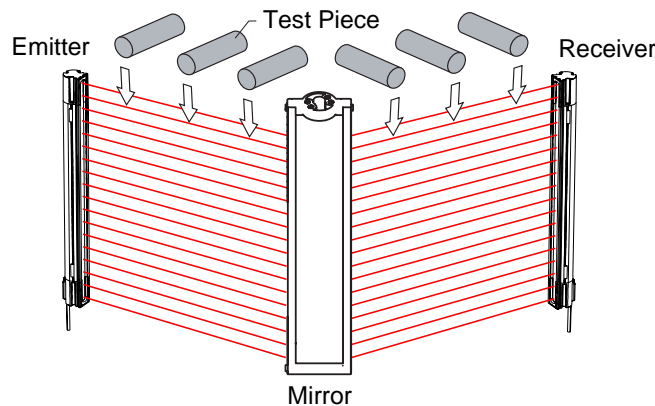

6. If a cascade system is in use in the application: Test the defined area of each sensing pair (for example, light curtain system 1, light curtain system 2, etc.).

7. If the S4B System passes all checks during the trip test, go on to ["Electrical Connections to the Guarded Machine" on page 40.](#)

## 6.5 Electrical Connections to the Guarded Machine

Verify that power has been removed from the S4B System and the guarded machine. Make the permanent electrical connections as required by each individual application.

Lockout/tagout procedures may be required (refer to OSHA 1910.147, ANSI Z244-1, ISO 14118, or the appropriate standard for controlling hazardous energy). Follow relevant electrical standards and wiring codes, such as the NEC, NFPA79 or IEC 60204-1.

Supply power and external device monitoring (EDM) should already be connected. The S4B must also have been aligned and passed the Initial Checkout, as described in ["Initial Checkout Procedure" on page 35](#).

The final connections to be made or verified are:

- OSSD outputs
- FSD interfacing
- MPCE/EDM

### WARNING:



- **Risk of electric shock**
- Failure to follow these instructions could result in serious injury or death.
- Disconnect or turn off power before installing, removing, or servicing the device.
- Install and connect the device in accordance with the National Electrical Code (NEC) and any applicable local code requirements and supply the device with an appropriate fuse box or circuit breaker (see *Specifications*).

### 6.5.1 OSSD Output Connections

Refer to the output specifications in the ["Specifications" on page 16](#) and these warnings before making OSSD output connections and interfacing the S4B to the machine.

### WARNING:



- **Interfacing both output signal switching devices (OSSD)**
- Failure to follow these instructions could result in serious injury or death.
- Unless the same degree of safety is maintained, never wire an intermediate device(s) (PLC, PES, PC) between the safety module outputs and the master stop control element it switches such that a failure causes a loss of the safety stop command or the failure allows the safety function to be suspended, overridden, or defeated.
- Connect both OSSD outputs to the machine control so that the machine's safety-related control system interrupts the circuit to the machine primary control element(s), resulting in a non-hazardous condition.

### WARNING:



- **OSSD Interfacing**
- Failure to properly interface the OSSD Outputs to the guarded machine could result in serious injury or death.
- To ensure proper operation, the Banner device output parameters and machine input parameters must be considered when interfacing the Banner device OSSD outputs to machine inputs. Design machine control circuitry so that all of the following are true:
  - The maximum load resistance value is not exceeded.
  - The maximum specified OSSD OFF-state voltage does not result in an ON condition.



## 6.5.2 Protective Stop (Safety Stop) Circuits

A protective stop (safety stop) allows for an orderly cessation of motion for safeguarding purposes, which results in a stop of motion and removal of power from the Machine Primary Control Elements (MPCE) (assuming this does not create additional hazards).

A protective stop circuit typically comprises a minimum of two normally open contacts from forced-guided, mechanically linked relays, which are monitored through External Device Monitoring (EDM) to detect certain failures, to prevent the loss of the safety function. Such a circuit can be described as a "safe switching point".

Typically, protective stop circuits are either single-channel, which is a series connection of at least two normally open contacts; or dual-channel, which is a separate connection of two normally open contacts. In either method, the safety function relies on the use of redundant contacts to control a single hazard. If one contact fails ON, the second contact arrests the hazards and prevents the next cycle from occurring. See "[Generic Wiring Diagram—8-pin Receiver and Redundant FSDs](#)" on [page 49](#).

The interfacing of the protective stop circuits must be accomplished so that the safety function cannot be suspended, overridden, or defeated, unless accomplished in a manner of the same or greater degree of safety as the machine's safety-related control system that includes the S4B.

The normally open safety outputs from an interface module provide a series connection of redundant contacts that form protective stop circuits for use in either single-channel or dual-channel control. See "[Generic Wiring Diagram—8-pin Receiver and Redundant FSDs](#)" on [page 49](#).

### Machine Primary Control Elements and EDM Input

A machine primary control element (MPCE) is an electrically powered element that directly controls the normal operation of a machine in such a way that it is the last element (in time) to function when machine operation is to be initiated or arrested (per IEC 61496-1). Examples include motor contactors, clutch/brakes, valves, and solenoids.

Depending on the level of risk of harm, it may be required to provide redundant MPCEs or other control devices that are capable of immediately stopping the dangerous machine motion, irrespective of the state of the other. These two machine control channels need not be identical (diverse redundant), but the stop time performance of the machine ( $T_s$ , used to calculate the safety distance, see "[Calculating the Safety Distance \(Minimum Distance\)](#)" on [page 20](#)) must take into account the slower of the two channels. Consult the machine manufacturer for additional information.

To ensure that an accumulation of failures does not compromise the redundant control scheme (cause a failure to danger), a method to verify the normal functioning of MPCEs or other control devices is required. S4B provides a convenient method for this verification: external device monitoring (EDM).

For the S4B external device monitoring to function properly, each device must include a normally closed, forced-guided (mechanically linked) contact that can accurately reflect the status of the device. This ensures that the normally open contacts, used for controlling hazardous motion, have a positive relationship with the normally closed monitoring contacts and can detect a failure to danger (for example, contacts that are welded closed or stuck On).

It is strongly recommended that a normally closed, forced-guided monitoring contact of each FSD and MPCE be connected in series with the EDM input (see "[Generic Wiring Diagram—8-pin Receiver and Redundant FSDs](#)" on [page 49](#)). If this is done, proper operation will be verified. Monitoring FSD and MPCE contacts is one method of maintaining control reliability (OSHA/ANSI) and Category 3 and 4 (ISO 13849-1).

If monitoring contacts are not available or do not meet the design requirement of being forced-guided (mechanically linked), it is recommended you:

- Replace the devices so that they are capable of being monitored; or
- Incorporate the EDM function into the circuit as close to the MPCE as possible (for example, monitor the FSDs); and
- Employ the use of well-trying, tested, and robust components, and generally accepted safety principles, including fault exclusion, into the design and installation to either eliminate, or reduce to an acceptable (minimal) level of risk, the possibility of undetected faults or failures that can result in the loss of the safety function.

The principle of fault exclusion allows the designer to design out the possibility of various failures and justify it through the risk assessment process to meet the required level of safety performance, such as the requirements of Category 2, 3, or 4. See ISO 13849-1/-2 for further information.


**WARNING:**

- **External Device Monitoring (EDM)**
- Creating a hazardous situation could result in serious injury or death.
- If the system is configured for “no monitoring,” it is the user’s responsibility to ensure this does not create a hazardous situation.

## External Device Monitoring

S4B Safety Light Curtain provides two possible EDM configurations: one-channel monitoring and no monitoring. Their functions are described below. The most common form of EDM is one-channel monitoring; its primary advantage is the simplicity of wiring. The installation must prevent short circuits across the normally closed monitoring contacts and to secondary sources of power.

Figure 20. One-channel EDM status, with respect to safety output

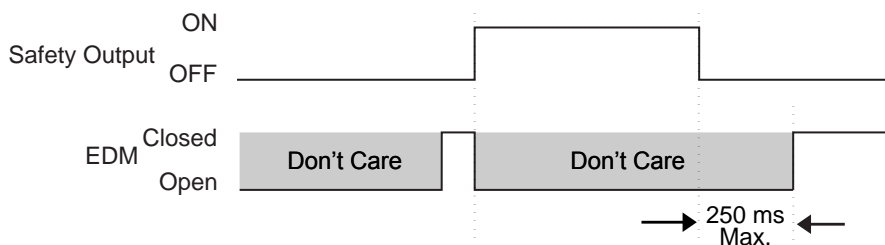

### External Device Monitoring Wiring

If not connected previously, it is again strongly recommended that one normally closed, forced-guided monitoring contact of each FSD and MPCE be wired as shown in the monitoring circuit (see ["Generic Wiring Diagram—8-pin Receiver and IM-T-9A Interface Module" on page 50](#)). Pin 4 of the receiver connector provides connection for the external device monitoring input.

External device monitoring (EDM) must be wired in one of two configurations described below.

**One-Channel Monitoring:** This is a series connection of normally closed monitor contacts that are force-guided (mechanically linked) from each device controlled by the S4B. The monitor contacts must be closed before the S4B OSSDs can turn On. After the safety outputs (OSSDs) turn On, the status of the monitor contacts are no longer monitored and may change state. However, the monitor contacts must be closed within 250 milliseconds of the OSSD outputs going from On to Off.

Refer to ["Generic Wiring Diagram—8-pin Receiver and IM-T-9A Interface Module" on page 50](#) for wiring. Connect the monitor contacts between +24 V DC and EDM (pin 4).

**No Monitoring:** Use this configuration to perform the initial checkout; see ["Initial Checkout Procedure" on page 35](#). If the application does not require the EDM function, it is the user's responsibility to ensure that this configuration does not create a hazardous situation.

To configure the S4B Safety Light Curtain for no monitoring, connect EDM (pin 4) to +24 V DC.



**CAUTION: Retrofit of two-channel EDM Installations**—In existing installations using two-channel external device monitoring (default setting of EZ-SCREEN and EZ-SCREEN LP systems), **the parallel wiring of the normally closed monitoring contacts must be rewired for the series connection used for one-channel EDM.** The S4B uses different cables and wire colors than the EZ-SCREEN and EZ-SCREEN LP systems. For the S4B to function the entire system must be rewired. **If there are any questions concerning retrofit installations, contact Banner Engineering.**

### 6.5.3 Preparing for System Operation

After the initial trip test has been accomplished, and the OSSD safety outputs connections have been made to the external control device, the S4B is ready for testing in combination with the guarded machine.

The operation of the S4B with the guarded machine must be verified before the combined System and machine may be put into service. To do this, a Qualified Person must perform the Commissioning Checkout Procedure. See ["Commissioning Checkout" on page 44](#).

### 6.5.4 Sensor Interchangeability

The figures and table below illustrate a wiring option that provides sensor interchangeability (or swapability)—the ability to install either sensor at either quick-disconnect connection.

The resulting installation provides the ability to swap the emitter and receiver position. This wiring option provides advantages during installation, wiring, and troubleshooting.

To use this option, connect all emitter wires in parallel (color-for-color) to the receiver cable via individual wires or the CSB.. splitter cordset.

Model CSB.. splitter cordsets and DEE2R.. double-ended cordsets allow easy interconnection between an S4B receiver and emitter, providing a single homerun cordset.

Figure 21. Individual Cordsets: 5-Wire

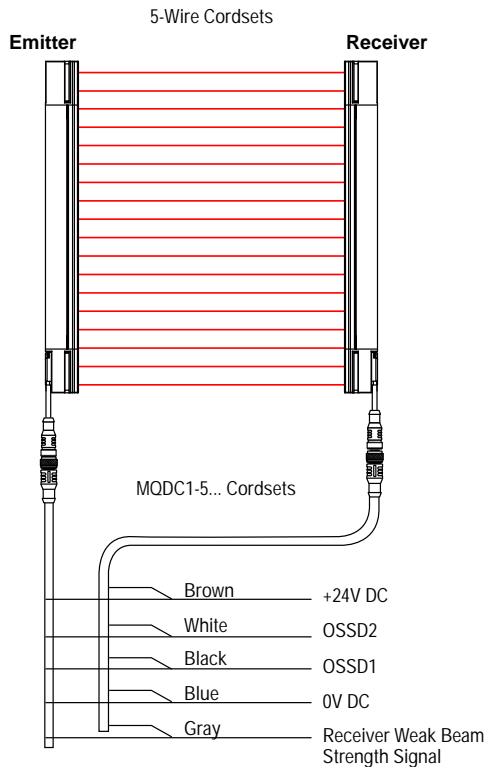


Figure 22. Individual Cordsets: 8-Wire


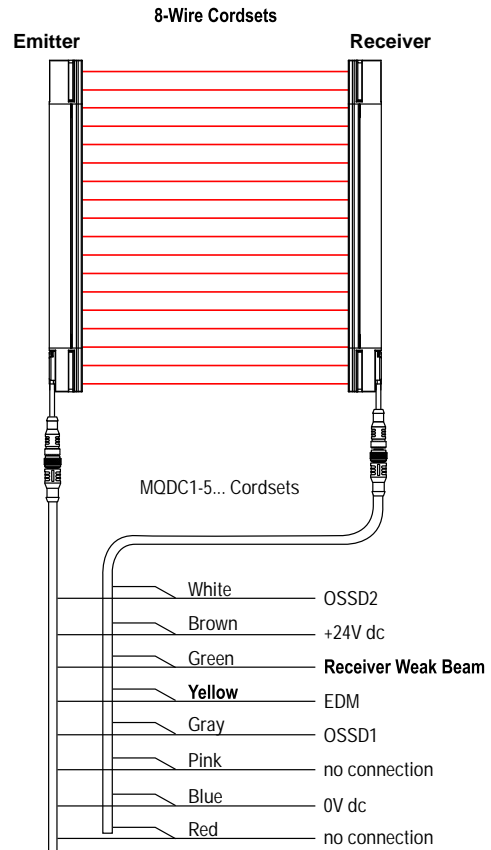


Figure 23. Splitter Cordsets

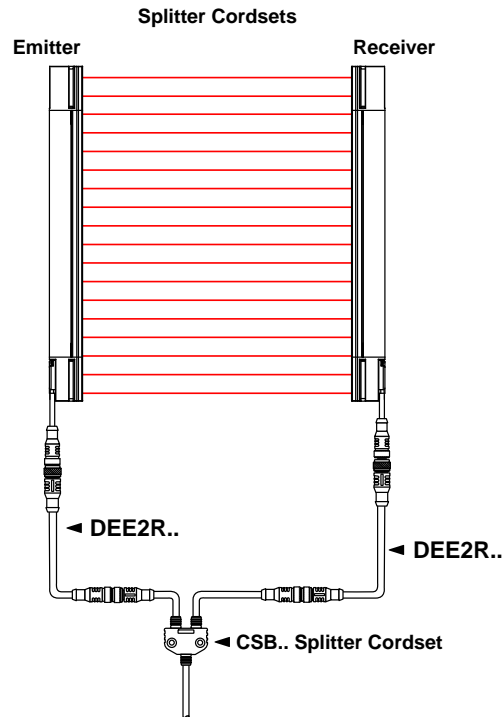

## 6.5.5 Commissioning Checkout

Perform this checkout procedure as part of the System installation after the System has been interfaced to the guarded machine, or whenever changes are made to the System (either a new configuration of the S4B or changes to the machine).

### WARNING:



- **Do not use the system until the checkouts are verified**
- Attempts to use the guarded/controlled machine before these checks are verified could result in serious injury or death.
- If all these checks cannot be verified, do not attempt to use the safety system that includes the Banner device and the guarded/controlled machine until the defect or problem has been corrected.

A Qualified Person must perform the procedure. Checkout results should be recorded and kept on or near the guarded machine as required by applicable standards.

To prepare the System for this checkout:

1. Examine the guarded machine to verify that it is of a type and design compatible with the S4B System. See ["Examples: Inappropriate Applications" on page 13](#) for a list of misapplications.
2. Verify that the S4B is configured for the intended application.
3. Verify that the safety distance (minimum distance) from the closest danger point of the guarded machine to the defined area is not less than the calculated distance, per ["Calculating the Safety Distance \(Minimum Distance\)" on page 20](#).
4. Verify that:
  - a. Access to any dangerous parts of the guarded machine is not possible from any direction not protected by the S4B System, hard (fixed) guarding, or supplemental safeguarding, and
  - b. It is not possible for a person to stand between the defined area and the dangerous parts of the machine, or
  - c. Supplemental safeguarding and hard (fixed) guarding, as described by the appropriate safety standards, are in place and functioning properly in any space (between the defined area and any hazard) which is large enough to allow a person to stand undetected by the S4B.
5. If used, verify that all reset switches are mounted outside and in full view of the guarded area, out of reach of anyone inside the guarded area, and that means of preventing inadvertent use is in place.

6. Examine the electrical wiring connections between the S4B OSSD outputs and the guarded machine's control elements to verify that the wiring meets the requirements stated in "[Electrical Connections to the Guarded Machine](#)" on page 40.
7. Inspect the area near the defined area (including work pieces and the guarded machine) for reflective surfaces (see "[Adjacent Reflective Surfaces](#)" on page 25). Remove the reflective surfaces, if possible, by relocating them, painting, masking or roughening them. Remaining problem reflections will become apparent during the trip test.
8. Verify that power to the guarded machine is off. Remove all obstructions from the defined area. Apply power to the S4B System.
9. Observe the Status indicators:
  - **Lockout:** Red Status flashing; Zone 1, Zone 2, or Zone 3 on red
  - **Blocked:** Red Status on; one or more red Zone indicators on
  - **Clear:** Green Status on; all green Zone indicators on
10. A Blocked condition indicates that one or more of the beams is misaligned or interrupted. See "[Optically Align the System Components](#)" on page 36 to correct this situation.
11. After the green Status indicator is on, perform the trip test ("[Conduct a Trip Test](#)" on page 38) on each sensing field to verify proper System operation and to detect possible optical short circuits or reflection problems. **Do not continue until the S4B passes the trip test.**

**IMPORTANT: Do not expose any individual to any hazard during the following checks.**



**WARNING:**

- **Clear the guarded area before applying power or resetting the system**
- Failure to clear the guarded area before applying power could result in serious injury or death.
- Verify that the guarded area is clear of personnel and any unwanted materials before applying power to the guarded machine or before resetting the system.


12. Apply power to the guarded machine and verify that the machine does not start up.
13. Interrupt (block) the defined area with the test piece and verify it is not possible for the guarded machine to be put into motion while the beam(s) is blocked.
14. Initiate machine motion of the guarded machine and, while it is moving, use the test piece to block the defined area. Do not attempt to insert the test piece into the dangerous parts of the machine. Upon blocking any beam, the dangerous parts of the machine must come to a stop with no apparent delay.
15. Remove the test piece from the beam; verify that the machine does not automatically restart, and that the initiation devices must be engaged to restart the machine.
16. Remove electrical power to the S4B system. Both OSSD outputs should immediately turn Off, and the machine must not be capable of starting until power is re-applied to the S4B.
17. Test the machine stopping response time, using an instrument designed for that purpose, to verify that it is the same or less than the overall system response time specified by the machine manufacturer.

**Do not continue operation until the entire checkout procedure is complete and all problems are corrected.**

## 6.6 Wiring Diagrams

### 6.6.1 Generic Emitter Wiring Diagram


Figure 24. Generic 5-Pin Emitter Wiring Diagram

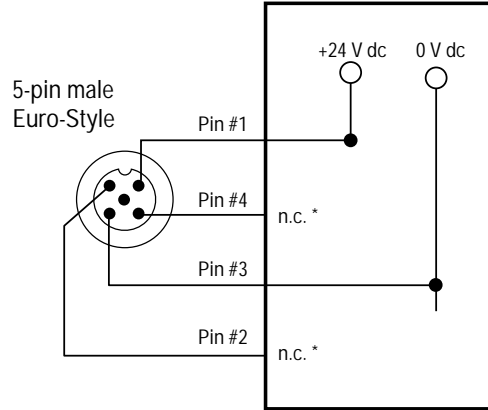

\* All pins shown as no connection (n.c.) are either not connected or are paralleled to same color wire from the receiver cable.

Mating MQDC1-5.. Cordset Pinout			M12 Connector (female face view)
Pin	Color	Emitter Function	
1	Brown	+ 24 V DC	
2	White	no connection	
3	Blue	0 V DC	
4	Black	no connection	
5	Gray	no connection	

Figure 25. Generic 8-Pin Emitter Wiring Diagram

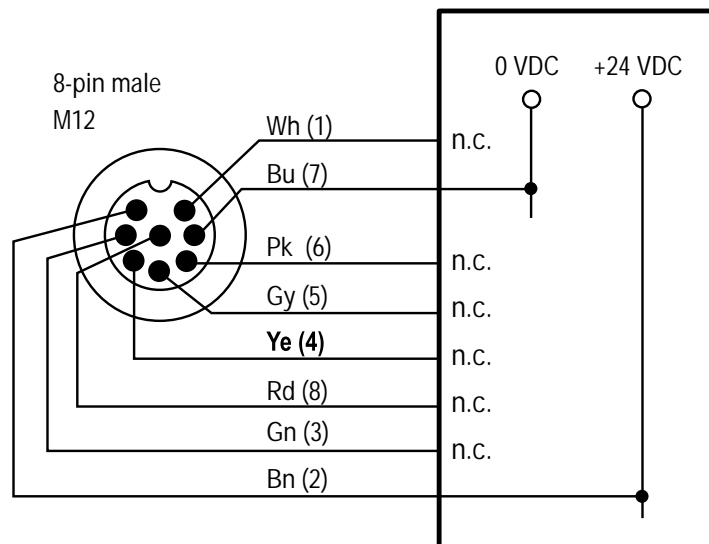


Mating SXA-xxxD Cordset Pinout			M12 Connector (female face view)
Pin	Color	Emitter Function	
1	White	no connection	
2	Brown	+ 24 V DC	
3	Green	no connection	
4	Yellow	no connection	
5	Gray	no connection	
6	Pink	no connection	
7	Blue	0 V	
8	Red	no connection	

### 6.6.2 Generic Wiring Diagram— 5-pin Receiver and Self-checking Safety Module, Safety Controller, Safety PLC

Generic wiring for a self-checking Safety module, Safety Controller, or Safety PLC (no monitoring, automatic reset).


Figure 26. Generic 5-Pin Receiver Wiring Diagram—Self-checking Safety Module, Safety Controller, Safety PLC

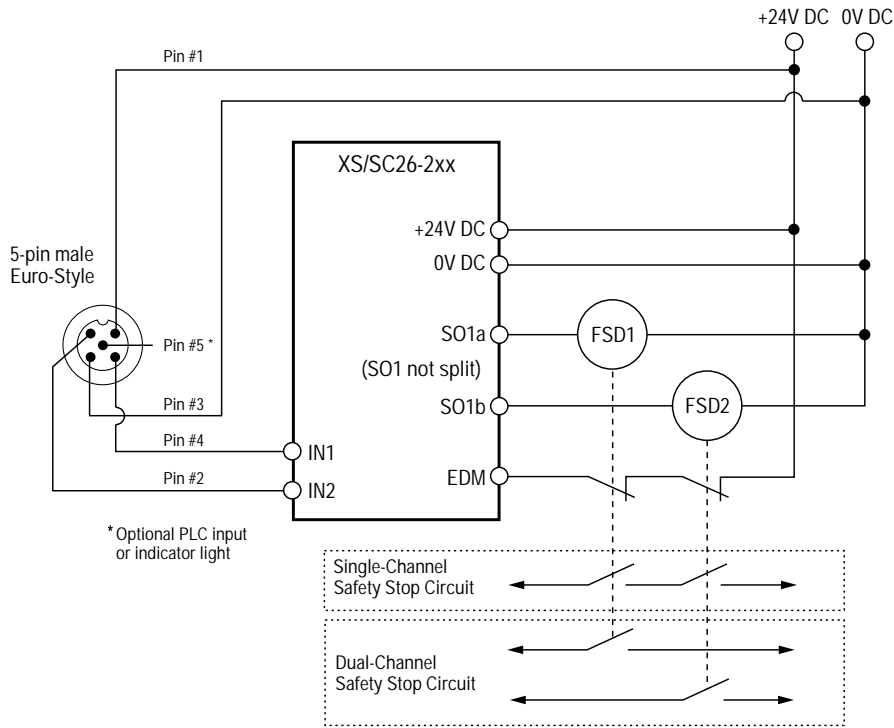

Mating MQDC1-5.. Cordset Pinout			M12 Connector (female face view)
Pin	Color	Receiver Function	
1	Brown	+ 24 V DC	
2	White	OSSD2	
3	Blue	0 V DC	
4	Black	OSSD1	
5	Gray	Weak beam strength	

### 6.6.3 Generic Wiring Diagram—8-pin Receiver and a Smart Device

Figure 27. Generic 8-Pin Receiver Wiring Diagram—Self-checking Safety Module, Safety Controller, Safety PLC

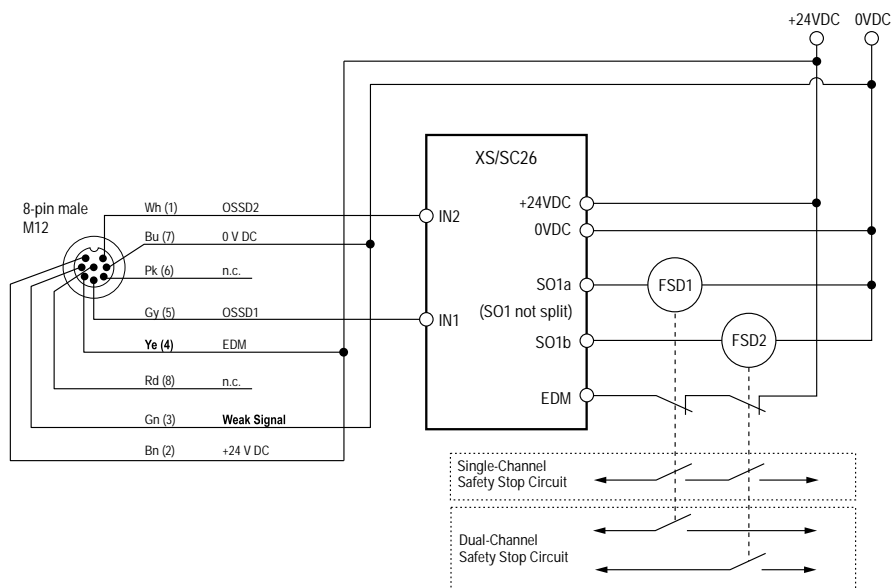


Mating SXA-xxxD Cordset Pinout			M12 Connector (female face view)
Pin	Color	Receiver Function	
1	White	OSSD2	
2	Brown	+ 24 V DC	
3	Green	Weak beam	
4	Yellow	EDM	
5	Gray	OSSD1	
6	Pink	no connection	
7	Blue	0 V	
8	Red	no connection	



### 6.6.4 Generic Wiring Diagram—8-pin Receiver and Redundant FSDs


Figure 28. Generic Wiring Diagram—8-pin Receiver and Redundant FSDs

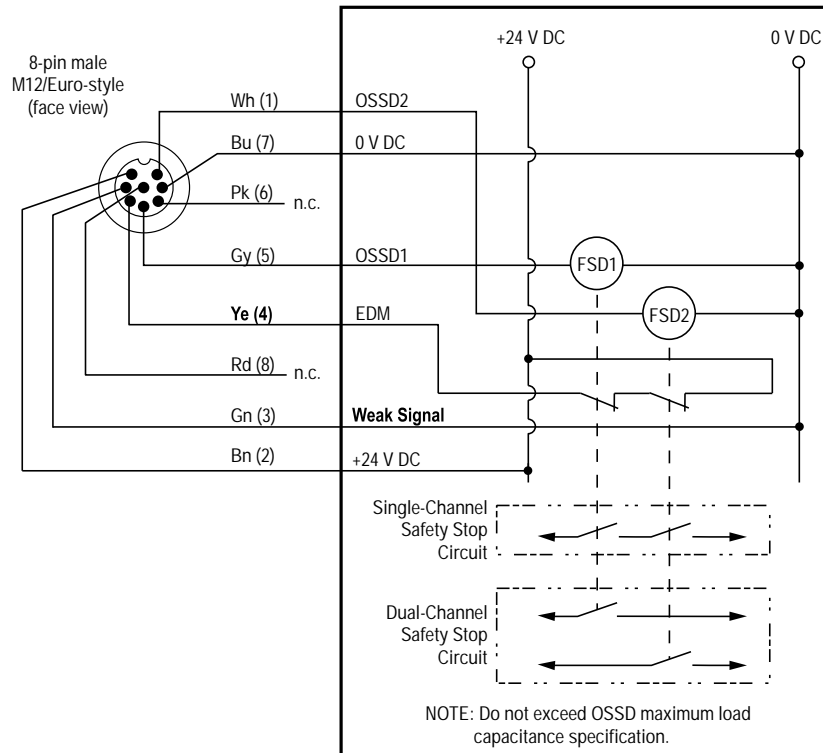

S4B 8-Pin Wiring		
Pin	Color	Receiver Function
1	White	OSSD2
2	Brown	+ 24 V DC
3	Green	Weak signal
4	Yellow	EDM
5	Gray	OSSD1
6	Pink	no connection
7	Blue	0 V
8	Red	no connection

### 6.6.5 Generic Wiring Diagram—8-pin Receiver and IM-T-9A Interface Module

Figure 29. Generic Wiring Diagram—IM-T-9A Interface Module (1-Channel EDM)

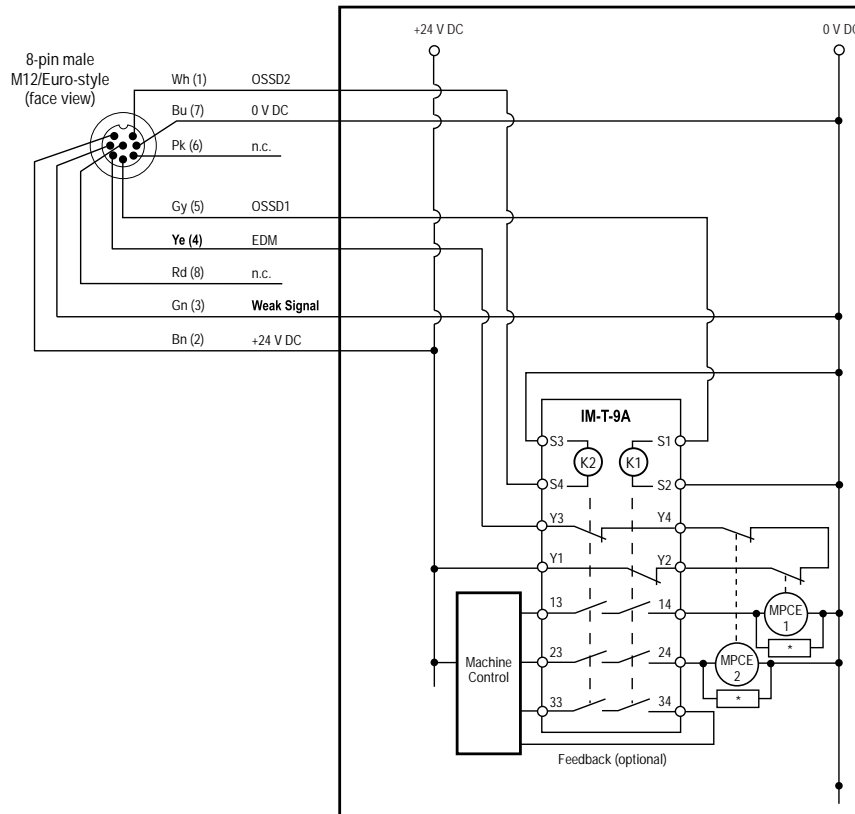

S4B 8-Pin Wiring			
Pin	Color		Receiver Function
1	White		OSSD2
2	Brown		+ 24 V DC
3	Green		Weak signal
4	Yellow		EDM
5	Gray		OSSD1
6	Pink		no connection
7	Blue		0 V
8	Red		no connection

## Chapter Contents

7.1 Security Protocol .....	51
7.2 Normal Operation .....	51
7.3 Periodic Checkout Requirements.....	53

## Chapter 7 System Operation

### 7.1 Security Protocol

Certain procedures for installing, maintaining, and operating the S4B System must be performed by either Designated Persons or Qualified Persons.

A **Designated Person** is identified and designated in writing, by the employer, as being appropriately trained and qualified to perform system resets and the specified checkout procedures on the S4B. The Designated Person is empowered to:

- Perform manual resets and hold possession of the reset key
- Perform the Daily Checkout Procedure

A **Qualified Person**, by possession of a recognized degree or certificate of professional training, or by extensive knowledge, training, and experience, has successfully demonstrated the ability to solve problems relating to the installation of the S4B System and its integration with the guarded machine. In addition to everything for which the Designated Person is empowered, the Qualified Person is empowered to:

- Install the S4B System
- Perform all checkout procedures
- Make changes to the internal configuration settings
- Reset the System following a Lockout condition

### 7.2 Normal Operation

#### 7.2.1 System Power-Up

When power is applied, each sensor conducts self-tests to detect critical internal faults, determine configuration settings, and prepare the S4B for operation.

If either sensor detects a critical fault, scanning ceases, the receiver outputs remain Off and diagnostic information displays.

If no faults are detected, the S4B automatically enters Alignment mode, and the receiver looks for an optical sync pattern from the emitter.

If the receiver is aligned and receives the proper sync pattern, it enters Run mode and begins scanning to determine the blocked or clear status of each beam. No manual reset operation is required.

#### 7.2.2 Run Mode

If any beams become blocked while the S4B is running, the receiver outputs turn Off within the stated S4B response time (see "[Specifications](#)" on page 16). If all the beams then become clear, the receiver outputs come back On. No resets are needed. All required machine control resets are provided by the machine control circuit.

**Internal Faults (Lockouts):** If either sensor detects a critical fault, scanning ceases, the receiver outputs turn Off and diagnostic information displays. See "[Troubleshooting](#)" on page 54 for resolution of error/fault conditions.

#### 7.2.3 Emitter Indicators

A single Status indicator shows whether power is applied, and whether the emitter is in Run mode or a Lockout condition. Two Scan Code indicators show the scan code assigned to the emitter.

See "[Status Indicators](#)" on page 14 for additional information.

Emitter Operating Status	Status Indicator	Scan Code Indicator
Power-up	Red on 0.5 second, then 0.25 second off, then green on 0.5 second	Two LEDs red on, then flash green, then yellow on for 10 seconds to indicate scan code: <ul style="list-style-type: none"> <li>• One yellow LED = scan code 1</li> <li>• Two yellow LEDs = scan code 2</li> </ul>
Run Mode	Green <sup>(1)</sup>	Off
Lockout	Flashing Red <sup>(2)</sup>	Emitter Error: Zone 2 red on, Zone 3 off Cascade Error: Zone 2 off, Zone 3 red on

### 7.2.4 Receiver Indicators

A single Status indicator shows when the OSSD outputs are on (green) or off (red), or the System is in a Lockout condition (flashing red).

Zone indicators show whether a section of the defined area is aligned and clear, is blocked and/or misaligned, or is a section that has a channel with a weak beam strength. All models have three Zone indicators, each of which indicates Blocked/Clear/Weak Beam Strength conditions for approximately 1/3 of the total light curtain.

See "[Status Indicators](#)" on page 14 for additional information.

Operating Mode	Status Indicator	Zone Indicators	OSSD Outputs
Power up	Single flash red, off, single flash green, then red for the rest of the start-up testing	Three LEDs red on, then flash green, then yellow on for 10 seconds to indicate scan code. <ul style="list-style-type: none"> <li>• Zone 2 only = scan code 1</li> <li>• Zone 2 and Zone 3 = scan code 2</li> </ul>	Off
Checking cascading chain <sup>(3)</sup>	Off	Red or green	Off
Alignment mode—beam 1 blocked	Red	Zone 1 red, others off	Off
Alignment mode—beam 1 clear	Red	Red or green	Off
<b>Run mode—clear</b>			
Non-cascade/remote	Green	Green	On
Cascade host	Green flashing <sup>(4)</sup>		
<b>Run Mode—clear with weak beam strength</b>			
Non-cascade/remote	Green	Green or yellow	On
Cascade host	Green flashing <sup>(5)</sup>		
<b>Run mode—blocked</b>			
Non-cascade/blocked remote	Red	Red or green	Off
Cascade host blocked	Red	Red or green	Off
Cascade host remote blocked	Red	Red	Off
Lockout mode	Red flashing <sup>(6)</sup>	Zone 1 red = Output error OR Zone 2 red = Cascade error OR Zone 3 = Receiver Error  See " <a href="#">Receiver Error Codes</a> " on page 54 for more information.	Off

Continued on page 53

(1) Repeating sequence of 0.5 second off, 0.25 second on, 0.25 second off, 0.25 second on; for the quantity of units in cascade chain (2 to 4) then 0.5 second off. Sequence repeats every 10 seconds.  
 (2) Repeating sequence of 0.75 second on then 0.25 second off.  
 (3) At power up if units are added to the cascade chain or normal power up (verify number of units).  
 (4) Repeating sequence of 0.5 second off, 0.25 second on, 0.25 second off, 0.25 second on; for the quantity of units in cascade chain (2 to 4) then 0.5 second off. Sequence repeats every 10 seconds.  
 (5) Repeating sequence of 0.5 second off, 0.25 second on, 0.25 second off, 0.25 second on; for the quantity of units in cascade chain (2 to 4) then 0.5 second off. Sequence repeats every 10 seconds.  
 (6) Repeating sequence of 0.75 second on then 0.25 second off.

Continued from page 52

Operating Mode	Status Indicator	Zone Indicators	OSSD Outputs
Clearing cascade chain All units	Off	Zone 1 = Off Zone 2 and 3 = Alternately flashing yellow	Off

## 7.3 Periodic Checkout Requirements

To ensure continued reliable operation, the System must be checked out periodically. Banner Engineering highly recommends performing the System checkouts as described below. However, a Qualified Person should evaluate these recommendations, based on the specific application and the results of a machine risk assessment, to determine the appropriate content and frequency of checkouts.

**At every shift change, power-up, and machine setup change**, the Daily Checkout should be performed; this checkout may be performed by a Designated or Qualified Person.

**Semi-annually**, the System and its interface to the guarded machine should be thoroughly checked out; this checkout must be performed by a Qualified Person (see "[Schedule of Checkouts](#)" on page 63). A copy of these test results should be posted on or near the machine.

**Whenever changes are made to the System** (either a new configuration of the S4B System or changes to the machine), perform the Commissioning Checkout (see "[Commissioning Checkout](#)" on page 44).

**Verify Proper Operation** The S4B can operate as it is designed only if it and the guarded machine are operating properly, both separately and together. It is the user's responsibility to verify this, on a regular basis, as instructed in "[Schedule of Checkouts](#)" on page 63. Failure to correct such problems can result in an increased risk of harm. Before the System is put back into service, verify that the S4B System and the guarded machine perform exactly as outlined in the checkout procedures and any problem(s) are found and corrected.

Chapter Contents

8.1 Lockout Conditions..... 54  
 8.2 Receiver Error Codes..... 54  
 8.3 Electrical and Optical Noise ..... 55

# Chapter 8 Troubleshooting

## 8.1 Lockout Conditions

A Lockout condition causes both S4B OSSD outputs to turn off or remain off, sending a stop signal to the guarded machine. Each sensor provides diagnostic error codes to identify the cause(s) of lockouts.




The following tables indicate a sensor lockout condition:

Emitter Lockout Conditions	
Status indicator	Flashing red

Receiver Lockout Conditions	
Status indicator	Flashing red
Zone indicators	See "Receiver Error Codes" on page 54

To recover from a Lockout condition, correct all errors and cycle power to the device.

## 8.2 Receiver Error Codes

Indicators	Error Description	Appropriate Action
 <p>Flashing</p>	<p><b>Output error</b> caused by:</p> <ul style="list-style-type: none"> <li>• One or both outputs being shorted to a power supply (high or low)</li> <li>• Shorting OSSD 1 to OSSD 2</li> <li>• An overload (greater than 0.5 A)</li> </ul>	<ul style="list-style-type: none"> <li>• Disconnect the OSSD loads and reset the receiver.</li> <li>• If the error clears, the problem is in the OSSD load(s) or in the load wiring.</li> <li>• If the error continues with no load connected, replace the receiver.</li> <li>• Verify that the EDM line (yellow wire, pin 4) has +24 V DC when the outputs are off.</li> </ul>
 <p>Flashing</p>	<p><b>Receiver error</b> occurs because of excessive electrical noise or an internal failure.</p>	<ul style="list-style-type: none"> <li>• Perform a reset per Checkout Procedures: Daily Checkout Procedure.</li> <li>• If the error clears, perform a Daily Checkout procedure. If the System checks out, resume operation. If the System fails the Daily Checkout Procedure, replace the receiver.</li> <li>• If the error clears, check the external connections and configuration settings.</li> <li>• If the error continues, replace the receiver.</li> </ul>
 <p>Flashing</p>	<p><b>Cascade error</b> occurs when the number of units in the cascade chain has been reduced (a unit was removed).</p>	<ul style="list-style-type: none"> <li>• Determine where the unit was removed and restore it to the cascade system.</li> <li>• Verify that no cables have been damaged.</li> <li>• Clear the cascade system according to "Reduce the Number of Units in a Cascade Chain" on page 58 section.</li> <li>• If the error continues, replace the receiver.</li> </ul>

## 8.3 Electrical and Optical Noise

The S4B is designed and manufactured to be highly resistant to electrical and optical noise and to operate reliably in industrial settings. However, serious electrical and/or optical noise may cause a random nuisance trip.

In extreme electrical noise cases, a Lockout is possible. To minimize the effects of transitory noise, the S4B responds to noise only if the noise is detected on multiple consecutive scans. If random nuisance trips occur, check the following:

- Optical interference from adjacent light curtains or other photoelectrics
- Sensor input or output wires routed too close to noisy wiring

### 8.3.1 Checking for Sources of Electrical Noise

All S4B wiring is low voltage; running these wires alongside power wires, motor/servo wires, or other high-voltage wiring can inject noise into the S4B System. It is good wiring practice (and may be required by code) to isolate S4B wires from high-voltage wires.

1. Use the Banner model BT-1 Beam Tracker Alignment Aid (see "[Accessories](#)" on page 66) to detect electrical transient spikes and surges.
2. Cover the lens of the BT-1 with electrical tape to block optical light from entering the receiver lens.
3. Press the RCV button on the BT-1 and position the BT-1 on the wires going to the S4B or any other nearby wires.
4. If the BT-1's indicator turns on, check for sources of electrical noise and separate the S4B cordset from any high-voltage wiring, if applicable.
5. Install proper transient suppression across the load to reduce the noise.

### 8.3.2 Check for Sources of Optical Noise

1. Turn off the emitter or completely block the emitter.
2. Press the RCV button on the Banner BT-1 Beam Tracker Alignment Aid and move it across the full length of the receiver's sensing window to check for light at the receiver.
3. If the BT-1's indicator turns on, check for emitted light from other sources (other safety light curtains, grids or points, or standard photoelectric sensors).

## Chapter Contents

9.1 Overview of Cascading .....	56
9.2 Configuring Cascade Systems .....	57
9.3 Determining Interconnect Cordset Lengths.....	59
9.4 Response Time for Cascaded Light Curtains.....	59

## Chapter 9 Cascade

### 9.1 Overview of Cascading

All FID 2 or higher S4B emitters and receivers can be used as a standalone unit or as part of a cascade chain. The determining factor is the RD (removable disconnect) cordset used with the unit.

The cascaded sensor pairs can be any length, any number of beams, or have different resolutions (14 mm or 30 mm), as long as each emitter matches its receiver.

The control reliability, installation and alignment, electrical interface to the guarded machine, initial checkout, periodic checkout, troubleshooting and maintenance features of cascadeable models are functionally identical to those of the standard models.

Make a cascade interconnection by using the appropriate RD cordsets (one for host, one for middle remotes, one for last remote), see "[Accessories](#)" on page 66. All receivers in a cascade activate the same set of OSSD outputs: the OSSDs of the host receiver.

**NOTE:** In a cascaded system, all receivers are connected together, and all emitters are connected together.

#### WARNING:



- **Adjacent components can synchronize incorrectly**
- The light curtain's safety function is reduced when components are not synchronized correctly, creating an unsafe condition that could result in serious injury or death.
- When multiple systems are mounted closely together, or where a secondary emitter is in view (within  $\pm 5^\circ$ ) and within range of an adjacent receiver, a receiver can synchronize to the signal from the wrong emitter, reducing the safety function of the light curtain.

#### WARNING:



- **Use a scan code**
- If you do not use a scan code, a receiver can synchronize to the signal from the wrong emitter, reducing the safety function of the light curtain and creating an unsafe condition that could result in serious injury or death.
- Configure adjacent systems to use different scan codes (for example, set one system to use scan code 1 and the other system to use scan code 2). Perform a trip test to confirm the light curtain function.



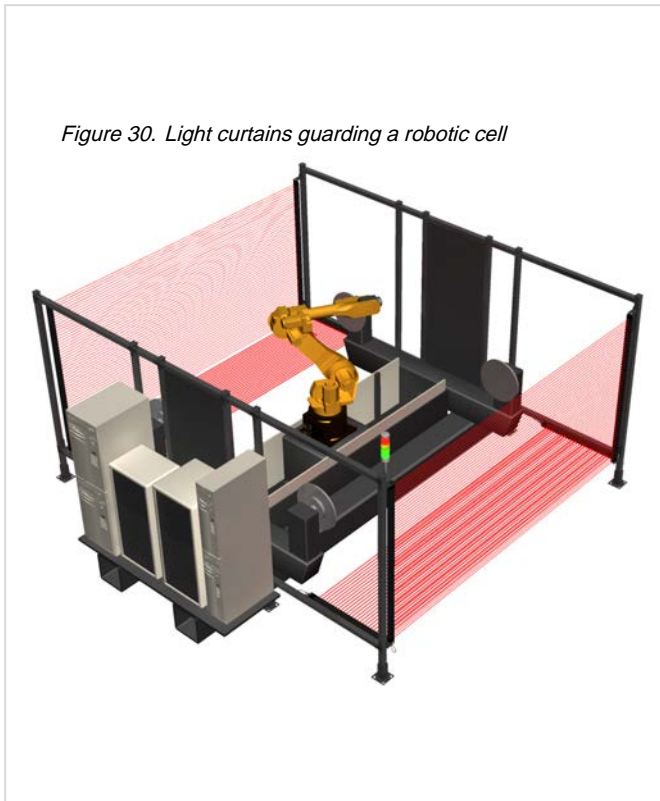


Figure 30. Light curtains guarding a robotic cell



Figure 31. Cascaded light curtains guarding a u-shaped cell

### 9.1.1 System Components and Specifications

A multiple-light curtain cascaded S4B system includes:

- Compatible emitter/receiver pairs (up to four)
- Two terminal RD (removable disconnect) cordsets for the last emitter and receiver in the cascade (ordered separately)
- Two RD cordsets and cables to interface with the machine and provide power to the system
- Pairs of double-ended (sensor interface) cables to interconnect the emitters and the receivers in the cascade
- A remote/host RD cordset for each center sensor (and double-ended cables if more than 0.61 m (2 ft) is needed) to interconnect the emitters and receivers in the cascade chain

Additional cordsets may be used to enable quick disconnect (QD) connections; see ["Cordsets "](#) on page 70.

Available single-ended, double-ended, and splitter cordsets are listed in ["Cordsets "](#) on page 70. Cordset lengths are limited—for both the machine interface/power cables and the sensor interconnect cables. See ["Determining Interconnect Cordset Lengths"](#) on page 59 for more information.


## 9.2 Configuring Cascade Systems

### 9.2.1 Initial Configuration or Add Units to the Cascade Chain

With power off, set up the cascade system.

All FID 2 S4B systems can be set in a cascade system by using the appropriate RD (removable disconnect) cordset. See ["Accessories"](#) on page 66 for various RD cordset models and kits for cascade systems of two, three, or four units.

Figure 32. Cascade Connections

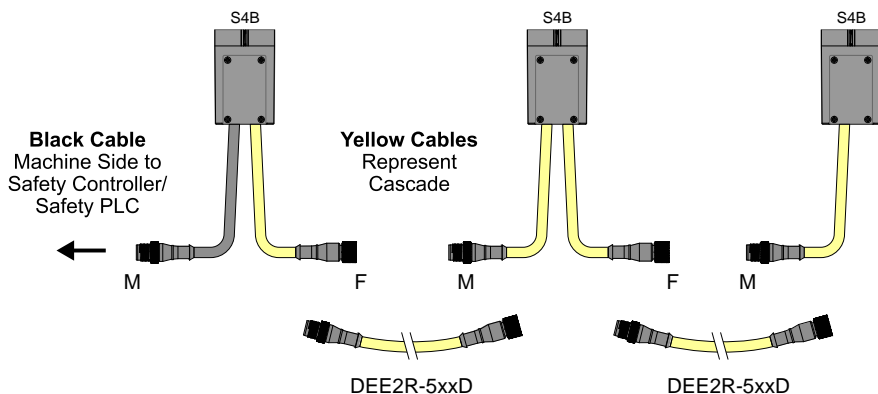

The machine interface cable is a black male 5- or 8-pin cable branch. All cascading cables are yellow 5-pin cable branches. The RD cordset of the host unit has a yellow female 5-pin cable branch for cascading. Each guest/remote sensor used in the center of a cascade system of three or four units needs a RD cordset that has two yellow 5-pin cable branches, one male and one female. The last unit in the cascade chain, terminal remote/guest, uses a terminal RD cordset which has one 5-pin male cable branch. The male/female is to ensure correct wiring of the system.

When the system powers on, it learns the number of units in the system. Once learned (less than a second), it enters run mode.

Every time the system powers on, it checks the number of units in the cascade system. If the number is as previously taught, it immediately enters run mode. If the number increases, it learns the new higher number and then enters run mode. If the number of units decreases, the system goes into a lockout state.


## 9.2.2 Reduce the Number of Units in a Cascade Chain

To reduce the number of units in a cascade chain, the existing configuration must be cleared.

To clear the existing configuration:

1. Remove the RD (removeable disconnect) cordset on the host receiver unit.
2. Set the switch to the clear cascade configuration setting by moving switch 2 to the right:

Figure 33. Set the Switches

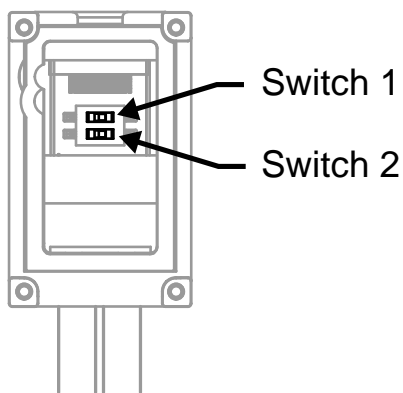

3. Return the RD cordset to the host unit.
4. Make sure the chain has been reduced to the appropriate number of units.
5. Turn power on to the system.
 

All receivers in the system should flash the Clearing Cascade Chain sequence—Zone 2 and Zone 3 indicator LEDs flashing yellow alternately for approximately 10 seconds.
6. Turn off power to the system.
7. Remove the RD cordset from the host unit again.
8. Move switch 2 to the left position (run mode).
9. Reinstall the RD cordset on the host unit.

10. Turn on the power to the system.  
The system enters run mode.

### 9.3 Determining Interconnect Cordset Lengths

The following cordset length chart lists the maximum machine interface cable length assuming the interconnection cable between cascaded systems uses the DEE2R-55D cable (15.8 m (52 ft)). As the machine interface cordset lengthens, the voltage available at the first (host) sensor pair decreases, which results in even lower voltages at the remote/guest receivers. The lengths noted are maximum lengths to ensure that the last cascaded sensor's supply voltage requirements are maintained.

Table 8. Maximum machine interface cable length versus total load current (OSSDs)

Maximum Machine Interface Cordset Length					
Total Load Current (OSSD 1 + OSSD 2)					
S4B Receivers in Cascade	0.1 A	0.25 A	0.5 A	0.75 A	1.0 A
1	95.7 m (314 ft)	78 m (256 ft)	54.9 m (180 ft)	42.1 m (138 ft)	34.1 m (112 ft)
2	76.2 m (250 ft)	61 m (200 ft)	45.7 m (150 ft)	36.6 m (120 ft)	29 m (95 ft)
3	53.3 m (175 ft)	44.2 m (145 ft)	33.5 m (110 ft)	27.4 m (90 ft)	22.9 m (75 ft)
4	33.5 m (110 ft)	29 m (95 ft)	22.9 m (75 ft)	19.8 m (65 ft)	16.8 m (55 ft)

**NOTE:** Emitter and receiver power (current) requirements are accounted for. The above values represent additional current draw that must be accounted for.

**NOTE:** Maximum cordset lengths are intended to ensure that adequate power is available to the S4B System when the supply is operating at +20 V DC. Values in the previous table are worse case. Contact Banner Engineering if there are any questions.

**NOTE:** The length of Emitter machine interface cordsets can be two times longer than those listed for the receiver in the table above if a CSB Splitter cordset is not used. If a CSB Splitter cordset is used, connect one branch of the CSB splitter to the receiver and other branch to the emitter via DEE2R double-ended cordset up to the same length listed in the table above.

**NOTE:** In determining these maximum machine interface cable lengths, the DEE2R-550D cable was used as the interconnection between system in the cascade chain (15.8 m (52 ft)).

### 9.4 Response Time for Cascaded Light Curtains

Response time is an important factor in determining the safety distance (minimum distance) of a light curtain.

For cascaded S4B Systems, that response time is dependent on the number of light curtains, length and resolution of the light curtains, and their positions in the cascade chain. The response time can be calculated in three ways:

- Based on the worst-case S4B System response time for the entire cascade chain (S4BE14-1200-S's response time of 30.5 ms); all light curtains in the cascade system have the same safety distance
- Based on the slowest response of the actual receivers used in the S4B cascade System; all light curtains in the cascade system have the same safety distance
- Individually for each light curtain in the cascade system; the safety distance is calculated for each light curtain in the cascade system

**NOTE:** For all cascade systems, the response time of the host receiver is not affected by the cascade response delay when cascading receivers to it. The hosts response time is always its response time when blocked.

**WARNING:**

- **Properly install the device**
- Failure to follow the installation instructions can result in ineffective or non-operation of the Banner device, which could create an unsafe condition resulting in serious injury or death.
- Follow all installation instructions.

### 9.4.1 Determining Worst Case System Response Time

If the safety distance is not important, that is, the light curtains will be mounted well beyond the safety distance, the worst-case timing can be used.

This worst case is based on the S4B receiver with the slowest response time. For 14 mm resolution models, this is the S4BR14-1200-S, which has a 30.5 ms response time. For 30 mm resolution models, this is the S4BR30-1800-S, which has a response time of 20 ms. In the safety distance formula,  $T_r$  is the response time of the light curtain:

$$D_s = K(T_s + T_r) + D_{pf}$$

If the cascade system has one guest/remote receiver, the worst-case response time is  $T_r$  for a two-receiver cascade system and is:

- 45.5 ms for 14 mm resolution units
- 35 ms for 30 mm resolution units

If the cascade system has two guest/remote receivers, the worst-case response time is  $T_r$  for a three-receiver cascade system and is:

- 50.5 ms for 14 mm resolution units
- 40 ms for 30 mm resolution units

If the cascade system has three guest/remote receivers, the worst-case response time is  $T_r$  for a four-receiver cascade system and is:

- 55.5 ms for 14 mm resolution units
- 45 ms for 30 mm resolution units

Remember, the response time of the host receiver is not affected by the cascade response delay when cascading receivers to it. The hosts response time is always its response time when blocked.

### 9.4.2 Determining System Response Time

If the safety distance does not need to be optimized (at a minimum), determine the receiver with the longest response time  $T_{r(max)}$ , and then add the cascade delay time to its response time.

$$D_s = K(T_s + T_r) + D_{pf}$$

If the cascade system has one guest/remote receiver, the cascade response time delay is 15 ms. Therefore, for a two-receiver cascade system:

$$T_r = T_{r(max)} + 15 \text{ ms}$$

If the cascade system has two guest/remote receivers, the cascade response time delay is 20 ms. Therefore, for a three-receiver cascade system:

$$T_r = T_{r(max)} + 20 \text{ ms}$$

If the cascade system has three guest/remote receivers, the cascade response time delay is 25 ms. Therefore, for a four-receiver cascade system:

$$T_r = T_{r(max)} + 25 \text{ ms}$$

Remember, the response time of the host receiver is not affected by the cascade response delay when cascading receivers to it. The hosts response time it always its response time when blocked.

### 9.4.3 Individual Response Time and Safety (Minimum) Distance

When calculating the individual safety distance for each emitter/receiver pair, the pair's position (host or guest) in the cascade affects its response time, which then affects its safety distance (see safety distance formulas in "[Calculating the Safety Distance \(Minimum Distance\)](#)" on page 20). The individual method results in an optimized safety distance for each light curtain in the cascade, while ensuring that each sensor pair is located at an adequate distance from the hazard.

The response time depends on if the light curtain is host or one of the guests/remotes. The number of guest receivers affects the response time of all the guest receivers cascaded. To calculate the response time for each emitter/receiver pair in the cascade system use the following formulas:

Position #1 (host response times not affected):

$$Tr_{(host)} = Tr$$

Guest Receiver in a two-receiver cascade system (1 guest):

$$Tr_{(guest)} = Tr + 15 \text{ ms}$$

Guest Receiver in a three-receiver cascade system (2 guests):

$$Tr_{(guest)} = Tr + 20 \text{ ms}$$

Guest Receiver in a four-receiver cascade system (3 guests):

$$Tr_{(guest)} = Tr + 25 \text{ ms}$$

Tr is the response time of the receiver found in the model table (see "[Models](#)" on page 10).

### 9.4.4 Recovery Time (Off to On) for Cascaded Light Curtains

When a system goes from blocked to clear, the system performs a number of tests before turning on its outputs. This is the recovery time. The recover time is a critical factor in muting applications because it affects the placement of the mute sensors.

In a cascade system, the recovery time of the host is not affected by the fact it is being used in a cascade system. However, the recovery time of the master/host does affect the system recovery time even when it is a remote/guest that is going from blocked to cleared.

For unit recovery times see the model table in "[Models](#)" on page 10.

In a cascade system, the recovery time of a guest is affected by the number of units in the cascade system. If the sync beam (the first beam, closest to cable) is blocked, the recovery time of a guest is affected by its own recovery time and the recovery time of the host.

To determine the typical recovery time of a cascade system, use the following formulas:

Sync Beam Blocked:

$$R_s = 0.38R_h + 2 \times (0.71R_g) + B$$

Non-Sync Beams (only) Blocked:

$$R_s = 0.38R_h + 0.71R_g + B$$

$R_s$  is the system recovery time when a remote/guest goes from blocked to clear.

$R_h$  is the standalone recovery time of the host, based on sensor length and resolution.

$R_g$  is the standalone recovery time of the guest, based on sensor length and resolution.

B is the bus delay adder, dependent on the number of guests in the system:

- 1 guest (2 pair cascade system) B = 4.5 ms
- 2 guests (3 pair cascade system) B = 7.06 ms
- 3 guests (4 pair cascade system) B = 9.62 ms

**Example**

Host S4BR30-900-S

Guest S4BR30-1800-S

Sync Beam Blocked:  $R_s = 0.38 \times 54 + 2 \times 0.71 \times 91 + 4.5 = 154 \text{ ms}$ Non-Sync Beam Blocked:  $R_s = 0.38 \times 54 + 0.71 \times 91 + 4.5 = 90 \text{ ms}$

Chapter Contents

10.1 Schedule of Checkouts ..... 63

# Chapter 10 Checkout Procedures

This section lists the schedule of checkout procedures and describes where each procedure is documented. Checkouts must be performed as described. Results should be recorded and kept in the appropriate place (for example, near the machine, and/or in a technical file).

Banner Engineering highly recommends performing the System checkouts as described. However, a Qualified Person (or team) should evaluate these generic recommendations, considering their specific application, and determine the appropriate frequency of checkouts. This will generally be determined by a risk assessment, such as the one contained in ANSI B11.0. The result of the risk assessment will drive the frequency and content of the periodic checkout procedures and must be followed.

## 10.1 Schedule of Checkouts

Checkout cards and this manual can be downloaded at [www.bannerengineering.com](http://www.bannerengineering.com).

Checkout Procedure	When to Perform	Where to Find the Procedure	Who Must Perform the Procedure
Trip Test	At Installation  Any time the System, the guarded machine, or any part of the application is altered.	"Conduct a Trip Test" on page 38	Qualified Person
Commissioning Checkout	At Installation  Whenever changes are made to the System (for example, either a new configuration of the S4B or changes to the guarded machine).	"Commissioning Checkout" on page 44	Qualified Person
Shift/Daily Checkout	At each shift change  Machine setup change  Whenever the System is powered up  During continuous machine run periods, this checkout should be performed at intervals not to exceed 24 hours.	<b>Daily Checkout Card</b> (Banner p/n 230288) A copy of the checkout results should be recorded and kept in the appropriate place (for example, near or on the machine, in the machine's technical file).	Designated Person or Qualified Person
Semi-Annual Checkout	Every six months following System installation, or whenever changes are made to the System (either a new configuration of the S4B or changes to the machine).	<b>Semi-Annual Checkout Card</b> (Banner p/n 230289) A copy of the checkout results should be recorded and kept in the appropriate place (for example, near or on the machine, in the machine's technical file).	Qualified Person

Chapter Contents

11.1 Cleaning..... 64  
 11.2 Warranty Service ..... 64  
 11.3 Manufacturing Date ..... 64  
 11.4 Disposal..... 64  
 11.5 Banner Engineering Corp Limited Warranty ..... 64  
 11.6 Contact Us..... 65

# Chapter 11 Product Support and Maintenance

## 11.1 Cleaning

Clean components with mild detergent or window cleaner and a soft cloth.  
 Avoid cleaners containing alcohol, as they may damage the polycarbonate housing.

## 11.2 Warranty Service

Contact Banner Engineering for troubleshooting of this device. **Do not attempt any repairs to this Banner device; it contains no field-replaceable parts or components.** If the device, device part, or device component is determined to be defective by a Banner Applications Engineer, they will advise you of Banner’s RMA (Return Merchandise Authorization) procedure.

**IMPORTANT:** If instructed to return the device, pack it with care. Damage that occurs in return shipping is not covered by warranty.

## 11.3 Manufacturing Date

Every S4B produced is marked with a code that defines the week and year of manufacture and manufacturing location. The code format (U.S. Standard format) is: **YYWWL**

- YY = Year of manufacture, 2 digits
- WW = Week of manufacture, 2 digits
- L = Banner-specific code, 1 digit

**Example:** 2309H = 2023, Week 9.

## 11.4 Disposal

Devices that are no longer in use should be disposed of according to the applicable national and local regulations.

## 11.5 Banner Engineering Corp Limited Warranty

Banner Engineering Corp. warrants its products to be free from defects in material and workmanship for one year following the date of shipment. Banner Engineering Corp. will repair or replace, free of charge, any product of its manufacture which, at the time it is returned to the factory, is found to have been defective during the warranty period. This warranty does not cover damage or liability for misuse, abuse, or the improper application or installation of the Banner product.

**THIS LIMITED WARRANTY IS EXCLUSIVE AND IN LIEU OF ALL OTHER WARRANTIES WHETHER EXPRESS OR IMPLIED (INCLUDING, WITHOUT LIMITATION, ANY WARRANTY OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE), AND WHETHER ARISING UNDER COURSE OF PERFORMANCE, COURSE OF DEALING OR TRADE USAGE.**

This Warranty is exclusive and limited to repair or, at the discretion of Banner Engineering Corp., replacement. **IN NO EVENT SHALL BANNER ENGINEERING CORP. BE LIABLE TO BUYER OR ANY OTHER PERSON OR ENTITY FOR ANY EXTRA COSTS, EXPENSES, LOSSES, LOSS OF PROFITS, OR ANY INCIDENTAL, CONSEQUENTIAL OR SPECIAL DAMAGES RESULTING FROM ANY PRODUCT DEFECT OR FROM THE USE OR INABILITY TO USE THE PRODUCT, WHETHER ARISING IN CONTRACT OR WARRANTY, STATUTE, TORT, STRICT LIABILITY, NEGLIGENCE, OR OTHERWISE.**

Banner Engineering Corp. reserves the right to change, modify or improve the design of the product without assuming any obligations or liabilities relating to any product previously manufactured by Banner Engineering Corp. Any misuse, abuse, or improper application or installation of this product or use of the product for personal protection applications when the product is identified as not intended for such purposes will void the product warranty. Any modifications to this product without prior express approval by Banner Engineering Corp will void the product warranties. All specifications published in this document are subject to change;



Banner reserves the right to modify product specifications or update documentation at any time. Specifications and product information in English supersede that which is provided in any other language. For the most recent version of any documentation, refer to: [www.bannerengineering.com](http://www.bannerengineering.com).

For patent information, see [www.bannerengineering.com/patents](http://www.bannerengineering.com/patents).

## 11.6 Contact Us

Banner Engineering Corp. headquarters is located at: 9714 Tenth Avenue North | Minneapolis, MN 55441, USA | Phone: + 1 888 373 6767

For worldwide locations and local representatives, visit [www.bannerengineering.com](http://www.bannerengineering.com).

Chapter Contents

12.1 Safety Controllers ..... 66

12.2 Interface Modules ..... 66

12.3 Contactors ..... 67

12.4 In-Line Sensor Status Indicator ..... 67

12.5 Literature ..... 67

12.6 Brackets ..... 67

12.7 RD Cordsets—FID 1 Models ..... 68

12.8 RD Cordsets—FID 2 Models ..... 68

12.9 Cordsets ..... 70

12.10 Test Piece ..... 72

12.11 Universal (Input) Safety Modules ..... 72

12.12 Alignment Aids ..... 72

12.13 SSM Series Corner Mirrors ..... 72

12.14 MSA Series Stands ..... 73

12.15 Muting Accessories ..... 74

# Chapter 12 Accessories

## 12.1 Safety Controllers

Safety Controllers provide a fully configurable, software-based safety logic solution for monitoring safety and non-safety devices.

For additional models and XS26 expansion modules, see instruction manual p/n [174868](#).

Table 9. Safety controller models

Non-Expandable Models	Expandable Models	Description
SC26-2	XS26-2	26 convertible I/O and 2 redundant solid-state safety outputs
SC26-2d	XS26-2d	26 convertible I/O and 2 redundant solid-state safety outputs with display
SC26-2e	XS26-2e	26 convertible I/O and 2 redundant solid-state safety outputs with Ethernet
SC26-2de	XS26-2de	26 convertible I/O and 2 redundant solid-state safety outputs with display and Ethernet
SC10-2roe		10 inputs, 2 redundant relay safety outputs (3 contacts each) (ISD and Ethernet compatible)
	XS26-ISDd	26 inputs, 2 redundant solid-state safety outputs with display, Ethernet, and 8 ISD channels

## 12.2 Interface Modules

Interface modules provide forced-guided, mechanically-linked relay (safety) outputs for the S4B System with an 8-pin interconnect (with EDM function). The interface module is required to be monitored by the EDM function and should not be used with S4B System with a 5-pin RD (removable disconnect) cordset. See the referenced Banner datasheets for more information.

Model	Description	Datasheet
IM-T-9A	Interface module, 3 normally open (N.O.) redundant-output 6 amp contacts, removable screw terminals	62822
IM-T-11A	Interface module, 2 normally open (N.O.) redundant-output 6 amp contacts, plus 1 normally closed (N.C.) auxiliary contact, removable screw terminals	
SR-IM-9A	Interface module, 3 normally open (N.O.) redundant-output 6 amp contacts, spring clamp terminals	208873
SR-IM-11A	Interface module, 2 normally open (N.O.) redundant-output 6 amp contacts, plus 1 normally closed (N.C.) auxiliary contact, spring clamp terminals	

## 12.3 Contactors

If used, two contactors are required per S4B System that is monitored by the EDM circuit and should not be used with the S4B system with a 5-pin RD (removable disconnect) cordset. See Banner datasheet p/n [111881](#) for more information.

Model	Description
<b>11-BG00-31-D-024</b>	10 amp positive-guided contactor, 3 normally open (N.O.) and 1 normally closed (N.C.)
<b>BF1801L024</b>	18 amp positive-guided contactor, 3 normally open (N.O.) and 1 normally closed (N.C.) (N.C. contact rated at 10 amps)

## 12.4 In-Line Sensor Status Indicator

The S15LRGPQ provides in-line sensor status indication of the output status of the 5-pin host or stand alone S4B receiver. See datasheet p/n [212217](#) for more information.



- Connects in line with receiver cable
- Translucent white PUR body
- Fully encapsulated IP66, IP67, and IP68 body

## 12.5 Literature

The following documentation are available at no charge.


Contact Banner Engineering or visit [www.bannerengineering.com](http://www.bannerengineering.com).

Part Number	Description
<b>230287</b>	S4B Safety Light Curtain Instruction Manual
<b>230288</b>	Daily Checkout Procedure Card
<b>230289</b>	Semi-Annual Checkout Procedure Card

## 12.6 Brackets


### S4BA-MBK-11

- End mount bracket
- ±15° rotation
- Glass-filled polycarbonate adapter
- 8-Gauge cold-rolled steel, black zinc finish L-bracket
- Includes two brackets

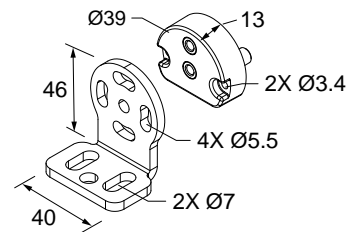

### S4BA-MBK-16

- Side mount bracket
- ±15° rotation
- Glass-filled polycarbonate
- Includes two brackets

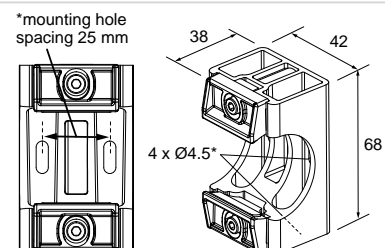

## 12.7 RD Cordsets—FID 1 Models

A RD (removable disconnect) cordset is required to connect directly to the sensor housing. The quick disconnect connector can then be used for cable-to-cable interconnections and connection to other devices.

FID 1 S4B units (units with no FID # printed on them) use the following DES4E-51D double-ended cordset.

**IMPORTANT:** This cordset is **not** compatible with FID 2 units.

Table 10. 5-Pin Threaded M12 Cordset—Double-Ended

Model	Length	Style	Dimensions	Pinout (Male)
DES4E-51D	0.3 m (1 ft)	Male Straight		<ul style="list-style-type: none"> <li>1 = Brown</li> <li>2 = White</li> <li>3 = Blue</li> <li>4 = Black</li> <li>5 = Gray</li> </ul>

## 12.8 RD Cordsets—FID 2 Models

A RD (removable disconnect) cordset is required to connect directly to the sensor housing. The quick disconnect connector can then be used for cable-to-cable interconnections and connection to other devices.

The RD cordset branches are needed to cascade S4B sensors.

FID 2 S4B units (see "S4B Light Curtains with Different FIDs" on page 11) require the use of one of the RD cordsets from the following table.

**IMPORTANT:** These cordsets are **not** compatible with FID 1 units.

Table 11. 5-Pin and 8-Pin Threaded M12 Cordsets—Double-Ended

Model	Length (L)	Style	Use	Dimensions	Pinout
DES4-M51-D	0.4 m (1.31 ft)	Male Straight	5-pin, male, black, stand-alone RD cordset		<p><b>Male</b></p> <ul style="list-style-type: none"> <li>1 = Brown</li> <li>2 = White</li> <li>3 = Blue</li> <li>4 = Black</li> <li>5 = Gray</li> </ul>
DES4-M81-D	0.4 m (1.31 ft)	Male Straight	8-pin, male, black, stand-alone RD cordset		<p><b>Female</b></p> <ul style="list-style-type: none"> <li>1 = White</li> <li>2 = Brown</li> <li>3 = Green</li> <li>4 = Yellow</li> <li>5 = Gray</li> <li>6 = Pink</li> <li>7 = Blue</li> <li>8 = Red</li> </ul>

Continued on page 69

Continued from page 68

Model	Length (L)	Style	Use	Dimensions	Pinout
<b>DES4-M51-F51-D</b>	Male branch 400 mm; Female Branch 350 mm	Male Straight/ Female Straight	5-pin, male, black RD cordset and 5-pin, female, yellow RD cordset, first (host) unit in cascade chain		<p><b>Male</b></p> <p><b>Female</b></p>
<b>DES4-M81-F51-D</b>	Male branch 400 mm; Female Branch 350 mm	Male Straight/ Female Straight	8-pin, male, black RD cordset and 5-pin, female, yellow RD cordset, first (host) unit in cascade chain		<p><b>Male</b></p> <p><b>Female</b></p>
<b>DES4-M51-F51-D-REM</b>	Male branch 400 mm; Female Branch 350mm	Male Straight/ Female Straight	5-pin, female, yellow RD cordset and 5-pin, male, yellow RD cordset for middle units in cascade chain		<p><b>Male</b></p> <p><b>Female</b></p>
<b>DES4-M51-RTP</b>	0.4 m (1.31 ft)	Male Straight	5-pin, male, yellow RD cordset for last unit in cascade chain		<p><b>Male</b></p>

Table 12. Cascade System Cordset Kits

Model	Length	Use	Quantity	Includes
<b>S4BA-Cascade-2</b>	0.4 m (1.31 ft)	Two sensor cascade system with 5-pin male M12 host	DES4-M51-F51-D DES4-M51-RTP	2
<b>S4BA-Cascade-3</b>	0.4 m (1.31 ft)	Three sensor cascade system with 5-pin male M12 host	DES4-M51-F51-D DES4-M51-F51-D-REM DES4-M51-RTP	2 2 2
<b>S4BA-Cascade-4</b>	0.4 m (1.31 ft)	Four sensor cascade system with 5-pin male M12 host	DES4-M51-F51-D DES4-M51-F51-D-REM DES4-M51-RTP	2 4 2
<b>S4BA-Cascade-2-M12M8</b>	0.4 m (1.31 ft)	Two sensor cascade system with 8-pin male M12 host	DES4-M81-F51-D DES4-M51-RTP	2 2
<b>S4BA-Cascade-3-M12M8</b>	0.4 m (1.31 ft)	Three sensor cascade system with 8-pin male M12 host	DES4-M81-F51-D DES4-M51-F51-D-REM DES4-M51-RTP	2 2 2

Continued on page 70

Continued from page 69



Model	Length	Use	Quantity	Includes
<b>S4BA-Cascade-4-M12M8</b>	0.4 m (1.31 ft)	Four sensor cascade system with 8-pin male M12 host	DES4-M81-F51-D	2
			DES4-M51-F51-D-REM	4
			DES4-M51-RTP	2

## 12.9 Cordsets

Machine interface cordsets provide power to the first emitter/receiver pair.

These cordsets have a M12 quick-disconnect connector on one end and are unterminated (cut to length) on the other end to interface with guarded machine. PVC cable jacket and PUR overmolded strain relief.

Table 13. MQDC1-5.. 5-pin M12 Quick-disconnect to flying lead cordsets




5-Pin Threaded M12 Cordsets—Single Ended				
Model	Length	Style	Dimensions	Pinout (Female)
MQDC1-501.5	0.5 m (1.5 ft)	Straight		 1 = Brown 2 = White 3 = Blue 4 = Black 5 = Gray
MQDC1-503	0.9 m (2.9 ft)			
MQDC1-506	2 m (6.5 ft)			
MQDC1-515	5 m (16.4 ft)			
MQDC1-530	9 m (29.5 ft)			
MQDC1-560	18 m (59 ft)			
MQDC1-5100	31 m (101.7 ft)			

Pin	Color	Emitter Function	Receiver Function
1	Brown	+24 V DC	+24 V DC
2	White	no connection	OSSD2
3	Blue	0 V DC	0 V DC
4	Black	no connection	OSSD1
5	Gray	no connection	Weak Beam Strength Output

Splitter cordsets are used for easy interconnection between an S4B receiver and its emitter, providing a single “homerun” cable. Model DEE2R-.. double-ended cordsets may be used to extend the QD trunk or either branch. (Branch #1 and branch #2 cable sections are 300 mm/1 ft long.)

Model MQDC1-5.. single-ended cordsets may be used to extend the quick disconnect trunk for cut-to-length applications.

The 5-pin splitter cordsets allow for an easy interconnection between the receiver and emitter, and provide a single trunk cable for the optional interchangeable (“swapable”) connection.

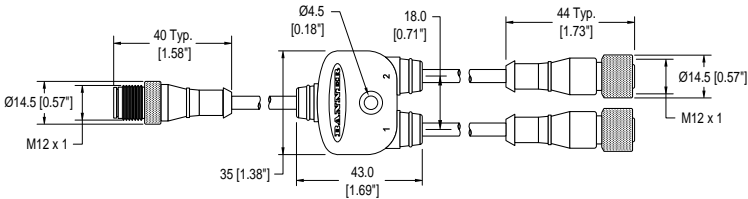5-Pin Threaded M12 Splitter Cordsets with Flat Junction—Double Ended				
Model	Trunk (Male)	Branches (Female)	Pinout (Male)	Pinout (Female)
CSB-M1251M1251	0.3 m (0.98 ft)	2 x 0.3 m (0.98 ft)		
CSB-M1258M1251	2.44 m (8 ft)			
CSB-M12515M1251	4.57 m (15 ft)			
CSB-M12525M1251	7.62 m (25 ft)			
CSB-UNT525M1251	7.62 m (25 ft) Unterminated			
			1 = Brown 2 = White 3 = Blue	4 = Black 5 = Green/Yellow

**DEE2R-5..D 5-pin M12/Euro-style QD to M12/Euro-style QD (female-male) cordsets—Use the DEE2R-5... cordsets to extend the length of cordsets and directly connect to other devices with a 5-pin M12/Euro-style quick disconnect. Other lengths are available.**

Model	Length	Banner Cordset Pinout/Color Code				M12 Connector (female face view)																					
DEE2R-51D	0.3 m (1 ft)	<table border="1"> <thead> <tr> <th>Pin</th> <th>Color</th> <th>Emitter Function</th> <th>Receiver Function</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>Brown</td> <td>+24 V dc</td> <td>+24 V dc</td> </tr> <tr> <td>2</td> <td>White</td> <td>no connection</td> <td>OSSD2</td> </tr> <tr> <td>3</td> <td>Blue</td> <td>0 V dc</td> <td>0 V dc</td> </tr> <tr> <td>4</td> <td>Black</td> <td>no connection</td> <td>OSSD1</td> </tr> <tr> <td>5</td> <td>Gn/Ye</td> <td>no connection</td> <td>Weak Beam Strength Output</td> </tr> </tbody> </table>	Pin	Color	Emitter Function	Receiver Function	1	Brown	+24 V dc	+24 V dc	2	White	no connection	OSSD2	3	Blue	0 V dc	0 V dc	4	Black	no connection	OSSD1	5	Gn/Ye	no connection	Weak Beam Strength Output	
Pin	Color		Emitter Function	Receiver Function																							
1	Brown		+24 V dc	+24 V dc																							
2	White		no connection	OSSD2																							
3	Blue		0 V dc	0 V dc																							
4	Black		no connection	OSSD1																							
5	Gn/Ye		no connection	Weak Beam Strength Output																							
DEE2R-53D	0.9 m (3 ft)																										
DEE2R-58D	2.5 m (8 ft)																										
DEE2R-515D	4.6 m (15 ft)																										
DEE2R-525D	7.6 m (25 ft)																										
DEE2R-550D	15.2 m (50 ft)																										
DEE2R-575D	22.9 m (75 ft)																										
DEE2R-5100D	30.5 m (100 ft)																										

**8-Pin Threaded M12 Cordsets—Flying Leads, Straight**

Model	Length	Dimensions	Pinout (Female)
SXA-815D	4.57 m (15 ft)		
SXA-825D	7.62 m (25 ft)		
SXA-850D	15.24 m (50 ft)		
SXA-8100D	30.48 m (100 ft)		

1 = White  
2 = Brown  
3 = Green  
4 = Yellow  
5 = Gray  
6 = Pink  
7 = Blue  
8 = Red

**8-Pin Threaded M12 Splitter Cordsets—Flat Junction**

Model	Trunk (Male)	Branches (Female)	Pinout
CSB-M1280M1280	No trunk	No branches	Male
CSB-M1281M1281	0.3 m (1 ft)	2 x 0.3 m (1 ft)	
CSB-M1288M1281	2.44 m (8 ft)		
CSB-M12815M1281	4.57 m (15 ft)		
CSB-M12825M1281	7.62 m (25 ft)		
CSB-UNT825M1281	7.62 m (25 ft) Unterminated		

Female

1 = Brown  
2 = Or/Bk  
3 = Orange  
4 = White  
5 = Black  
6 = Blue  
7 = Gn/Ye  
8 = Violet

## 12.10 Test Piece

Use a test piece during a trip test to verify the detection capability of the sensor.

Model	Description
STP-13	14 mm test piece (14 mm resolution systems)
STP-14	30 mm test piece (30 mm resolution systems)


## 12.11 Universal (Input) Safety Modules

UM-FA-xA Safety Modules are safety monitoring devices that provide forced-guided, mechanically-linked relay (safety) outputs for the S4B system.

See datasheet p/n [141249](#) for more information.

Model	Description
UM-FA-9A	3 normally open (N.O.) redundant-output 6 amp contacts
UM-FA-11A	2 normally open (N.O.) redundant-output 6 amp contacts, plus 1 normally closed (N.C.) auxiliary contact

## 12.12 Alignment Aids

Model	Description	
LAT-1-S4B	Self-contained visible-beam laser tool for aligning any S4B emitter/receiver pair. Includes retroreflective target material and mounting clip.	
S4BA-LAT-2	Clip-on retroreflective LAT target	
S4BA-LAT-SS	Replacement LAT-1 clip	
BRT-THG-2-100	2-inch retroreflective tape, 100 ft	
BT-1	Beam tracker	

## 12.13 SSM Series Corner Mirrors

- Robust for heavy-duty applications.
- Extra wide for use with long-range optical safety systems.
- Rear-surface glass mirrors are rated at 85% efficiency. The total sensing range decreases by approximately 8% per mirror. See mirror datasheet p/n [61934](#) or [www.bannerengineering.com](http://www.bannerengineering.com) for further information.
- To order the stainless steel reflective surface models, add the suffix **-S** (for example, **SSM-375-S**); range reduction for these models is approximately 30% per mirror. See datasheet p/n [67200](#).
- Robust construction, two mounting brackets and hardware included.
- In addition to the included SMA-MBK-1 brackets, an EZA-MBK-2 adapter bracket kit is required for use with MSA Series stands; refer to the mounting bracket accessories list.
- Brackets may be inverted from the positions shown, decreasing dimension L1 by 58 mm (2.3 in).



Mirror Model	Reflective Area Height (Y)	Mounting Height (L1) <sup>(1)</sup>	Overall Height (L2)	
SSM-100-S	100 mm (3.9 in)	211 mm (8.3 in)	178 mm (7.0 in)	
SSM-150-S	150 mm (5.9 in)	261 mm (10.3 in)	228 mm (9.0 in)	
SSM-200-S	200 mm (7.9 in)	311 mm (12.2 in)	278 mm (10.9 in)	
SSM-250-S	250 mm (9.8 in)	361 mm (14.2 in)	328 mm (12.9 in)	
SSM-375-S	375 mm (14.8 in)	486 mm (19.1 in)	453 mm (17.8 in)	
SSM-475-S	475 mm (18.7 in)	586 mm (23.1 in)	553 mm (21.8 in)	
SSM-550-S	550 mm (21.7 in)	661 mm (26.0 in)	628 mm (24.7 in)	
SSM-675-S	675 mm (26.6 in)	786 mm (31.0 in)	753 mm (29.6 in)	
SSM-825-S	825 mm (32.5 in)	936 mm (36.9 in)	903 mm (35.6 in)	
SSM-875-S	875 mm (34.4 in)	986 mm (38.8 in)	953 mm (37.5 in)	
SSM-975-S	975 mm (38.4 in)	1086 mm (42.8 in)	1053 mm (41.5 in)	
SSM-1100-S	1100 mm (43.3 in)	1211 mm (47.7 in)	1178 mm (46.4 in)	
SSM-1175-S	1175 mm (46.3 in)	1286 mm (50.6 in)	1253 mm (49.3 in)	
SSM-1275-S	1275 mm (46.3 in)	1386 mm (54.6 in)	1353 mm (53.3 in)	
SSM-1400-S	1400 mm (55.1 in)	1511 mm (59.5 in)	1478 mm (58.2 in)	
SSM-1475-S	1475 mm (58.1 in)	1586 mm (62.5 in)	1553 mm (61.1 in)	
SSM-1550-S	1550 mm (61.0 in)	1661 mm (65.4 in)	1628 mm (64.1 in)	
SSM-1675-S	1675 mm (65.9 in)	1786 mm (70.3 in)	1753 mm (69.0 in)	
SSM-1750-S	1750 mm (68.9 in)	1861 mm (73.3 in)	1828 mm (72.0 in)	
SSM-1900-S	1900 mm (74.8 in)	2011 mm (79.2 in)	1978 mm (77.9 in)	

SSM Models	Light Curtain Series					
	SLS	S4B	LP	LS	Type 2	SGS
SSM-100						
SSM-150						
SSM-200	150				150	
SSM-250						
SSM-375	300	300	270	280	300	
SSM-475			410	350/420		
SSM-550	450	450		490	450	2–500
SSM-675	600	600	550	560/630	600	
SSM-825	750	750	690	700/770	750	
SSM-875			830	840		3–400
SSM-975	900	900		910	900	4–300
SSM-1100	1050	1050	970	980/1050	1050	
SSM-1175			1110	1120		
SSM-1275	1200	1200		1190	1200	4–400
SSM-1400	1350	1350	1250	1260/1330	1350	
SSM-1475			1390	1400		
SSM-1550	1500	1500		1470	1500	
SSM-1675			1530	1540/1610		
SSM-1750	1650	1650	1670	1680	1650	
SSM-1900	1800	1800	1810	1750/1820	1800	

## 12.14 MSA Series Stands

- Provides mounting T-slots with 20 mm dimension between slots
- Base included. Available without a base by adding the suffix **NB** to the model number (for example, **MSA-S42-1NB**)

<sup>(1)</sup> The mounting brackets may be inverted from the positions shown at left (flanges pointing “inward” instead of “outward,” as shown). When this is done, dimension L1 decreases by 58 mm (2.3 in).

Stand Model	Pole Height	Useable Stand Height	Overall Stand Height	
MSA-S24-1	610 mm (24 in)	483 mm (19 in)	616 mm (24.25 in)	
MSA-S42-1	1065 mm (42 in)	938 mm (37 in)	1071 mm (42.2 in)	
MSA-S66-1	1676 mm (66 in)	1549 mm (61 in)	1682 mm (66.25 in)	
MSA-S84-1	2134 mm (84 in)	2007 mm (79 in)	2140 mm (84.25 in)	
MSA-S105-1	2667 mm (105 in)	2540 mm (100 in)	2673 mm (105.25 in)	

## 12.15 Muting Accessories

Use the S4BA mute arms with the S4B and a muting device (such as the Banner Safety Controllers).

Table 14. Muting Accessories

Model	Description
S4BA-ML-LPQ20	L-configuration mute arm kit One mute sensor arm (2 sensors) and one retroreflector arm (2 reflectors)
S4BA-MX-LPQ20	X-configuration mute arm kit One mute sensor arm (2 sensors) and one retroreflector arm (2 reflectors)
S4BA-MT-LPQ20	T-configuration mute arm kit One mute sensor arm (4 sensors) and one retroreflector arm (4 reflectors)
R95-6M125-M128-S4BM	Splitter box for combining 5-pin emitter, 5-pin receiver, and up to 4 mute sensors to an 8-pin M12 110 mm cable
S4BA-Q20-2VPLP-Q5	Q20 retroreflective mute sensor with 600 mm (23.6 in) cordset and M12 quick disconnect
BRT-2X2	Retroreflective target for use with mute sensor

## Chapter Contents

# Chapter 13 Glossary of Safety Terminology

## A

### ANSI (American National Standards Institute)

Acronym for the American National Standards Institute, an association of industry representatives that develops technical standards (including safety standards). These standards comprise a consensus from a variety of industries on good practice and design. ANSI standards relevant to the application of safety products include the ANSI B11 Series, and ANSI/RIA R15.06. See "[Standards and Regulations](#)" on page 7.

### Auto Power-Up

A safety light curtain system feature that enables the system to be powered up into Run mode (or recover from a power interruption) without requiring a manual reset.

### Auto Start/Restart (Trip) Condition

The safety outputs of a safety light curtain system turn off when an object completely blocks a beam. In an Auto Start/Restart condition, the safety outputs re-energize when the object is removed from the defined area.

### Auto Start/Restart (Trip) Initiate

The resetting of a safeguard causing the initiation of machine motion or operation. Auto Start/Restart Initiate is not allowed as a means to initiate a machine cycle per NFPA 79 and ISO 60204-1, and is commonly confused with PSDI.

## B

### Blanking

A programmable feature of a safety light curtain system that allows the light curtain to ignore certain objects located within the defined area. See **Floating Blanking** and **Reduced Resolution**.

### Blocked Condition

A condition that occurs when an opaque object of sufficient size blocks/interrupts one or more light curtain beams. When a blocked condition occurs, OSSD1 and OSSD2 outputs simultaneously turn off within the system response time.

### Brake

A mechanism for stopping, slowing, or preventing motion.

## C

### Cascade

Series connection (or "daisy-chaining") of multiple emitters and receivers.

### CE

Abbreviation for "Conformité Européenne" (French translation of "European Conformity"). The CE mark on a product or machine establishes its compliance with all relevant European Union (EU) Directives and the associated safety standards.

### Clutch

A mechanism that, when engaged, transmits torque to impart motion from a driving member to a driven member.

### Control Reliability

A method of ensuring the performance integrity of a control system or device. Control circuits are designed and constructed so that a single failure or fault within the system does not prevent the normal stopping action from being applied to the machine when required, or does not create unintended machine action, but does prevent initiation of successive machine action until the failure is corrected.

## CSA

Abbreviation for Canadian Standards Association, a testing agency similar to Underwriters Laboratories, Inc. (UL) in the United States. A CSA-certified product has been type-tested and approved by the Canadian Standards Association as meeting electrical and safety codes.

## D

### Defined Area

The "screen of light" generated by a safety light curtain system, defined by the height and the safety distance (minimum distance) of the system.

**Designated Person**

A person or persons identified and designated in writing, by the employer, as being appropriately trained and qualified to perform a specified checkout procedure.

**E****Emitter**

The light-emitting component of a safety light curtain system, consisting of a row of synchronized modulated LEDs. The emitter, together with the receiver (placed opposite), creates a "screen of light" called the defined area.

**External Device Monitoring (EDM)**

A means by which a safety device (such as a safety light curtain) actively monitors the state (or status) of external devices that may be controlled by the safety device. A lockout of the safety device will result if an unsafe state is detected in the external device. External device(s) may include, but are not limited to: MPCEs, captive contact relays/contactors, and safety modules.

**F****Failure to Danger**

A failure that delays or prevents a machine safety system from arresting dangerous machine motion, thereby increasing risk to personnel.

**Final Switching Device (FSD)**

The component of the machine's safety-related control system that interrupts the circuit to the machine primary control element (MPCE) when the output signal switching device (OSSD) goes to the OFF-state.

**Fixed Blanking**

A programming feature that allows a safety light curtain system to ignore objects (such as brackets or fixtures) that will always be present at a specific location within the defined area. The presence of these objects will not cause the system's safety outputs (for example, Final Switching Devices) to trip or latch. If any fixed objects are moved within or removed from the defined area, a Lockout condition results.

**Floating Blanking**

See **Reduced Resolution**.

**FMEA (Failure Mode and Effects Analysis)**

A testing procedure by which potential failure modes in a system are analyzed to determine their results or effects on the system. Component failure modes that produce either no effect or a Lockout condition are permitted; failures that cause an unsafe condition (a failure to danger) are not. Banner safety products are extensively FMEA tested.

**G****Guarded Machine**

The machine whose point of operation is guarded by the safety system.

**H****Hard (Fixed) Guard**

Screens, bars, or other mechanical barriers affixed to the frame of the machine intended to prevent entry by personnel into the hazardous area(s) of a machine, while allowing the point of operation to be viewed. The maximum size of the openings is determined by the applicable standard, such as Table O-10 of OSHA 29CFR1910.217, also called a "fixed barrier guard."

**Harm**

Physical injury or damage to the health of people, which may result through direct interaction with the machine or through indirect means, as a result of damage to property or to the environment.

**Hazard Point**

The closest reachable point of the hazardous area.

**Hazardous Area**

An area that poses an immediate or impending physical hazard.

**I****Internal Lockout**

A Lockout condition that is due to an internal safety system problem. Generally, indicated by the red Status indicator LED (only) flashing. Requires the attention of a Qualified Person.

**K**

**Key Reset (Manual Reset)**

A key-operated switch used to reset a safety light curtain system to Run mode following a Lockout condition, or to enable machine operation following a Manual Start/Restart (Latch) condition. Also refers to the act of using the switch.

**L****Lockout Condition**

A safety light curtain condition that is automatically attained in response to certain failure signals (an internal lockout). When a Lockout condition occurs, the safety light curtain's safety outputs turn OFF; the failure must be corrected and a manual reset is required to return the system to Run mode.

**M****Machine Primary Control Element (MPCE)**

An electrically powered element, external to the safety system, which directly controls the machine's normal operating motion in such a way that the element is last (in time) to operate when machine motion is either initiated or arrested.

**Machine Response Time**

The time between the activation of a machine-stopping device and the instant when the dangerous parts of the machine reach a safe state by being brought to rest.

**Manual Start/Restart (Latch) Condition**

The safety outputs of a safety light curtain system turn off when an object completely blocks a beam. In a Manual Start/Restart condition, the safety outputs stay off when the object is removed from the defined area. To re-energize the outputs, perform a proper manual reset.

**Minimum Object Sensitivity (MOS)**

The minimum-diameter object that a safety light curtain system can reliably detect. Objects of this diameter or greater will be detected anywhere in the defined area. A smaller object can pass undetected through the light if it passes exactly midway between two adjacent light beams. Also known as MODS (Minimum Object Detection Size). See also **Specified Test Piece**.

**Muting**

The automatic suspension of the safeguarding function of a safety device during a non-hazardous portion of the machine cycle.

**O****OFF State**

The state in which the output circuit is interrupted and does not permit the flow of current.

**ON State**

The state in which the output circuit is complete and permits the flow of current.

**OSHA (Occupational Safety and Health Administration)**

A U.S. Federal agency, the Division of the U.S. Department of Labor, that is responsible for the regulation of workplace safety.

**OSSD**

Output Signal Switching Device. The safety outputs that are used to initiate a stop signal.

**P****Part-Revolution Clutch**

A type of clutch that may be engaged or disengaged during the machine cycle. Part-revolution clutched machines use a clutch/brake mechanism, which can arrest machine motion at any point in the stroke or cycle.

**Pass-Through Hazard**

A pass-through hazard is associated with applications where personnel may pass through a safeguard (which issues a stop command to remove the hazard), and then continues into the guarded area, such as in perimeter guarding. Subsequently, their presence is no longer detected, and the related danger becomes the unexpected start or restart of the machine while personnel are within the guarded area.

**Point of Operation**

The location of a machine where material or a workpiece is positioned and a machine function is performed upon it.

**PSDI (Presence-Sensing Device Initiation)**

An application in which a presence-sensing device is used to actually start the cycle of a machine. In a typical situation, an operator manually positions a part in the machine for the operation. When the operator moves out of the danger area, the presence-sensing device starts the machine (no start switch is used). The machine cycle runs to completion, and the operator can then insert a new part and start another cycle. The presence-sensing device continually guards the machine. Single-break mode is used when the part is automatically ejected after the machine operation. Double-break mode is used when the part is both inserted (to begin the operation) and removed (after the operation) by the operator. PSDI is commonly confused with "Trip Initiate." PSDI is defined in OSHA CFR1910.217. Banner safety light curtain systems may not be used as PSDI devices on mechanical power presses, per OSHA regulation 29 CFR 1910.217.

**Q****Qualified Person**

A person who, by possession of a recognized degree or certificate of professional training, or who, by extensive knowledge, training and experience, has successfully demonstrated the ability to solve problems relating to the subject matter and work.

**R****Receiver**

The light-receiving component of a safety light curtain system, consisting of a row of synchronized phototransistors. The receiver, together with the emitter (placed opposite), creates a "screen of light" called the defined area.

**Reduced Resolution**

A feature that allows a safety light curtain system to be configured to produce an intentionally disabled light beam(s) within the light curtain, which increases the minimum object sensitivity. The disabled beam(s) appears to move up and down (float) to allow the feeding of an object through the defined area at any point without tripping the safety outputs (for example, OSSDs) and causing a Auto Start/Restart (Trip) or Manual Start/Restart (Latch) condition. Sometimes called Floating Blanking.

**Reset**

The use of a manually operated switch to restore the safety outputs to the On state from a lockout or a Manual Start/Restart (Latch) condition.

**Resolution**

See **Minimum Object Sensitivity**.

**S****Self-Checking (Circuitry)**

A circuit with the capability to electronically verify that all of its own critical circuit components, along with their redundant backups, are operating properly. Banner safety light curtain systems and safety modules are self-checking.

**Safety Distance**

The minimum distance required to allow the machine's hazardous motion to stop completely, before a hand (or other object) can reach the nearest hazard point. Measured from the midpoint of the defined area to the nearest hazard point. Factors that influence minimum separation distance include the machine stop time, the light curtain system response time, and the light curtain minimum object detection size.

**Specified Test Piece**

An opaque object of sufficient size used to block a light beam to test the operation of a safety light curtain system. When inserted into the defined area and placed in front of a beam, the test piece causes the outputs to de-energize.

**Supplemental Guarding**

Additional safeguarding device(s) or hard guarding, used to prevent a person from reaching over, under, through or around the primary safeguard or otherwise accessing the guarded hazard.

**T****Test Piece**

An opaque object of sufficient size used to block a light beam to test the operation of a safety light curtain system.

**U****UL (Underwriters Laboratory)**

A third-party organization that tests products for compliance with appropriate standards, electrical codes, and safety codes. Compliance is indicated by the UL listing mark on the product.

# Index

---

## A

- applications and limitation [12](#)
- alignment
  - optical [36](#)
- accessories
  - safety controller [66](#)

## B

- beam strength
  - weak [15](#)
- bracket [30](#)

## C

- checkout
  - initial [35](#)
  - periodic [53](#)
  - schedule of [63](#)
- corner mirrors [26](#)
- commissioning checkout [44](#)
- cascade [56](#)
- checkout procedure card
  - daily [67](#)
  - semi-annual [67](#)

## D

- daily checkout procedure card [67](#)

## E

- electrical noise [55](#)
- emitter
  - indicators [51](#)
  - indicators [14](#)
  - orientation [27](#)
- error codes [54](#)
- electrical noise sources [55](#)

## F

- FID [11](#)
- feature ID [11](#)

## I

- indicators
  - emitter [51](#)
  - receiver [52](#)
  - emitter [14](#)
  - receiver [14](#)

- installation
  - mechanical [19](#)

## L

- lockout [54](#)
- literature [67](#)

## M

- minimum distance [20](#)

## N

- noise sources
  - optical [55](#)
  - electrical [55](#)
- noise [55](#)

## O

- optical noise sources [55](#)
- optical noise [55](#)
- optical alignment [36](#)
- orientation [27](#)

## P

- power-up
  - system [51](#)

## R

- response time [10](#), [59](#)
- receiver
  - indicators [52](#)
  - error codes [54](#)
  - indicators [14](#)
  - orientation [27](#)

## S

- specifications
  - emitter [16](#)
  - receiver [17](#)
  - general [16](#)
- scan code [15](#), [34](#)
- safety distance [20](#)
- semi-annual checkout procedure card [67](#)
- safety controller [66](#)

## W

- weak beam strength [15](#)



 [LinkedIn](#)

 [Twitter](#)

 [Facebook](#)

